

WINDSOR WINDOWS & DOORS

NEXT DIMENSION CLASSIC SINGLE HUNG (NON-HVHZ) (NON-IMPACT)



WINDSOR WINDOWS & DOORS
900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH BASED ON QUANTITIES IN DP CHARTS NOT TO EXCEED THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH DIAMETER ITW TAPCONS, ELCO ULTRACONS, ELCO CRETE-FLEX OR HILTI KWIK-CON II OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #10 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- CLIP ANCHOR:** FOR INSTALLATION INTO WOOD FRAMING USE (2) #8 WOOD SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- CLIP ANCHOR:** FOR INSTALLATION INTO METAL STUD USE (2) #8 GR. 5 SELF-TAPPING SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND THE METAL STRUCTURE.
- NAIL FIN:** FOR INSTALLATION INTO WOOD FRAMING USE (1) #8 WOOD SCREWS OR (1) 10D COMMON NAIL OR (1) 11 GAUGE ROOFING NAIL PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- NAIL FIN:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #8 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

CONTINUED INSTALLATION NOTES:

- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
 - HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 1/8" (0.125").

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-08/11
 - AAMA 450-10
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: VINYL
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 9 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	ELEVATIONS & ANCHOR LAYOUTS
4	ELEVATIONS & ANCHOR LAYOUTS
5	ELEVATIONS & ANCHOR LAYOUTS
6	NAIL FIN INSTALLATION SECTIONS
7	THROUGH FRAME & CLIP INSTALLATION SECTIONS
8	CLIP INSTALLATION SECTIONS
9	LOCK RAIL DETAIL, MULLION DETAIL, AND GLAZING DETAIL


DESIGN PRESSURE TABLE					
TYP. OVERALL SIZE		DESIGN PRESSURE	CONFIGURATION	INSTALLATION METHOD	MISSILE IMPACT RATING
WIDTH	HEIGHT				
47.50"	83.50"	+40/-40 PSF	O/X	THROUGH FRAME, NAIL FIN & CLIP	NON - IMPACT
35.50"	95.50"	+35/-35 PSF	O/X		
95.50"	83.50"	+35/-35 PSF	O/X		
107.50"	83.50"	+35/-35 PSF	O/X		
35.50"	71.50"	+50/-50 PSF	O/X		

TITLE: NEXT DIMENSION CLASSIC SINGLE HUNG (NON-HVHZ)(NON-IMPACT) INSTALLATION AND GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

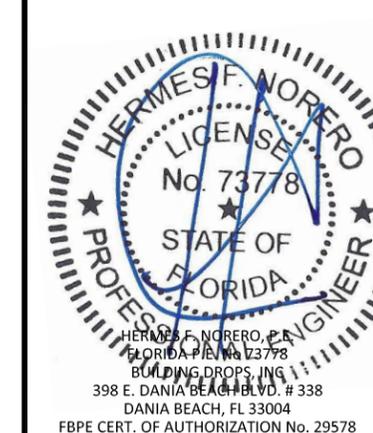

FL #:
FL14884

DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWD058**

SHEET:
1
OF 9

s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\14884\wwd058.dwg 12/22/2020 4:17 PM


TITLE: NEXT DIMENSION CLASSIC SINGLE HUNG (NON-HVHZ)(NON-IMPACT) ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

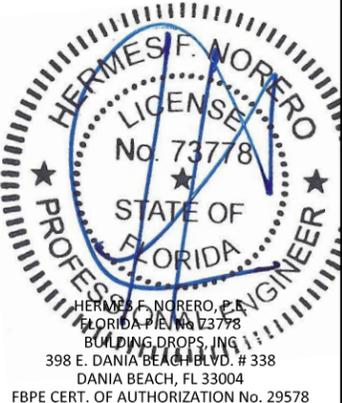

FL #: **FL14884**


DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET: **2**

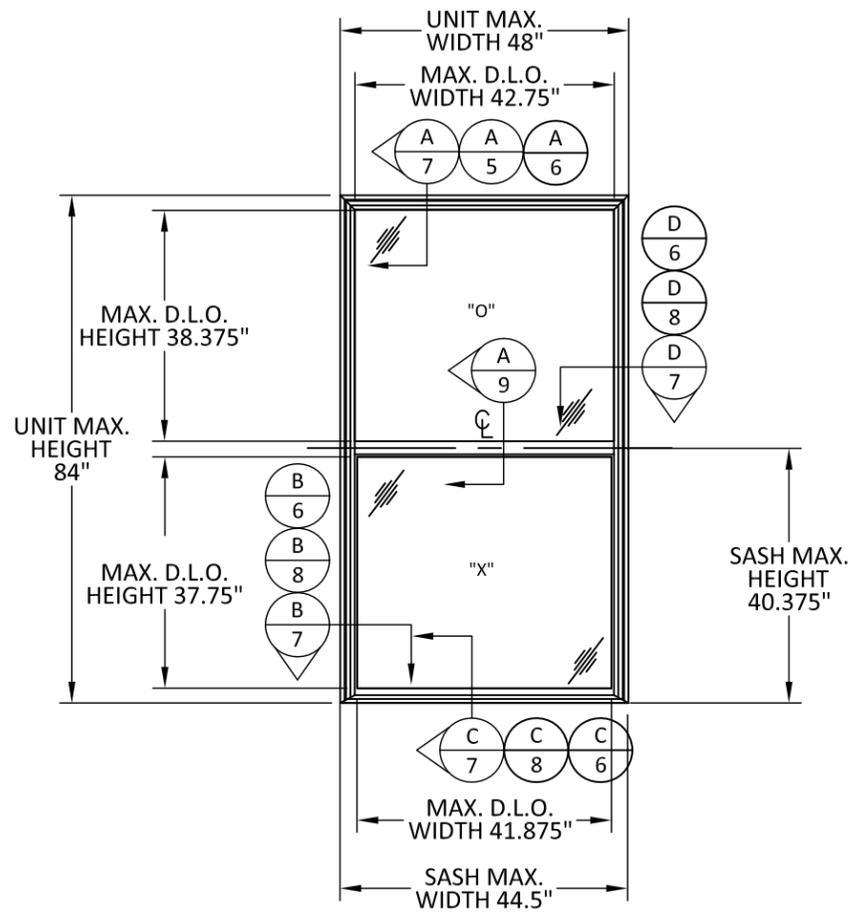

TYPICAL ELEVATION
NEXT DIMENSION CLASSIC SINGLE HUNG

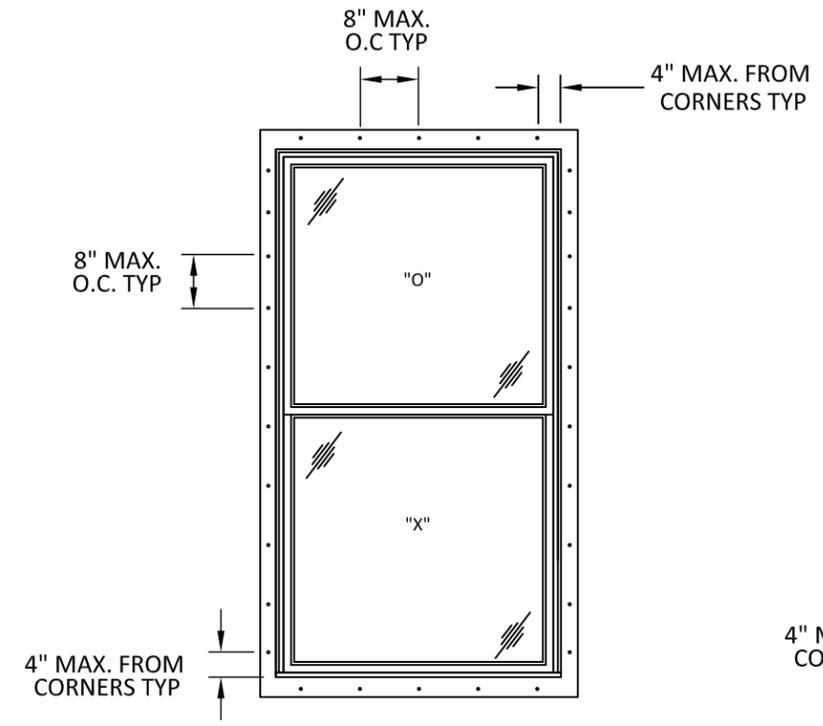

ANCHOR LAYOUT
NAIL FIN INSTALLATION

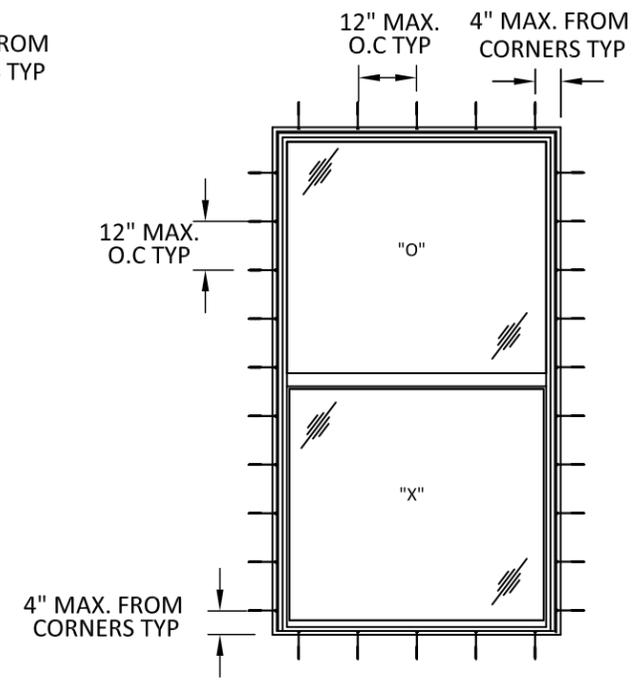

ANCHOR LAYOUT
SCREW OR CLIP INSTALLATION

12/22/2020 4:17 PM
s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg


TITLE: NEXT DIMENSION CLASSIC SINGLE HUNG (NON-HVHZ)(NON-IMPACT) ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: **BUILDING DROPS, INC.**
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

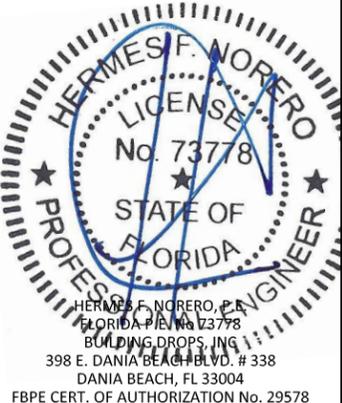

FL #: **FL14884**

DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET:

3


OF 9

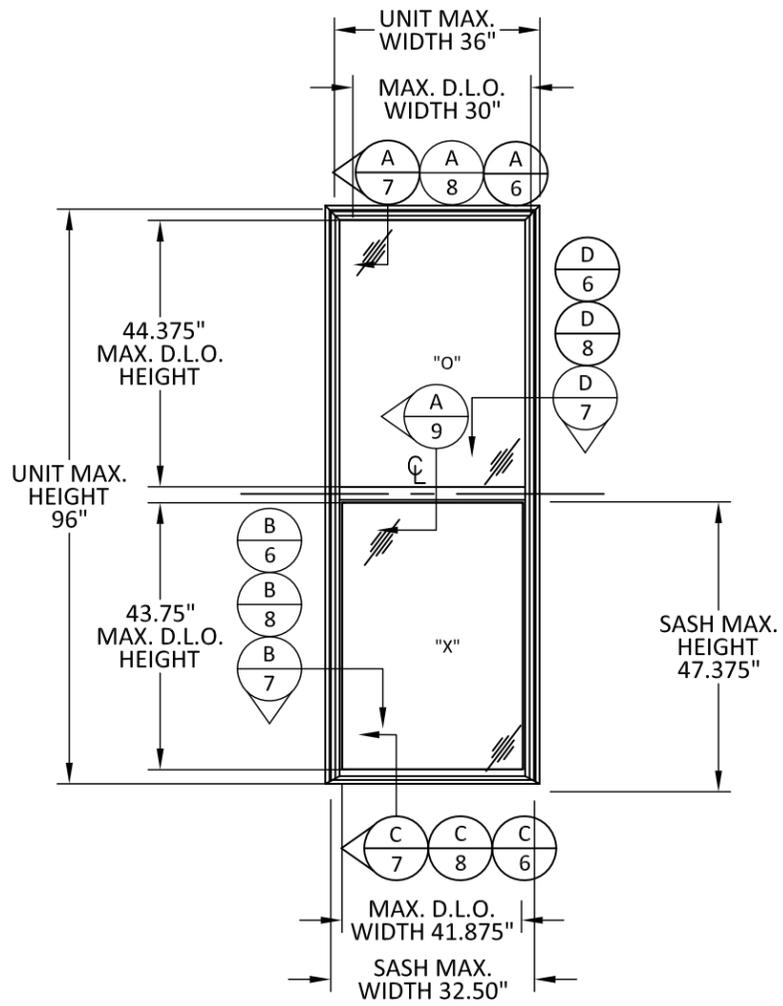

TYPICAL ELEVATION
NEXT DIMENSION CLASSIC SINGLE HUNG

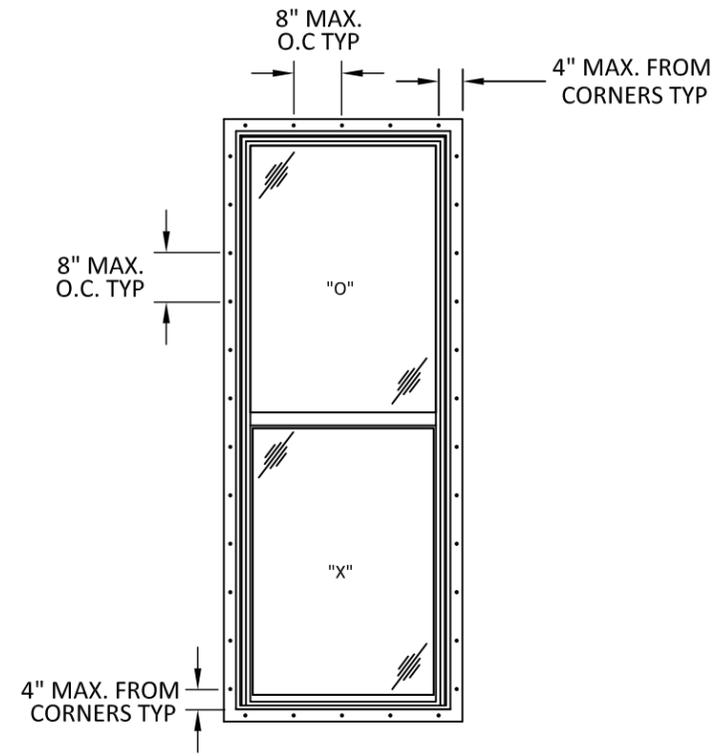

ANCHOR LAYOUT
NAIL FIN INSTALLATION

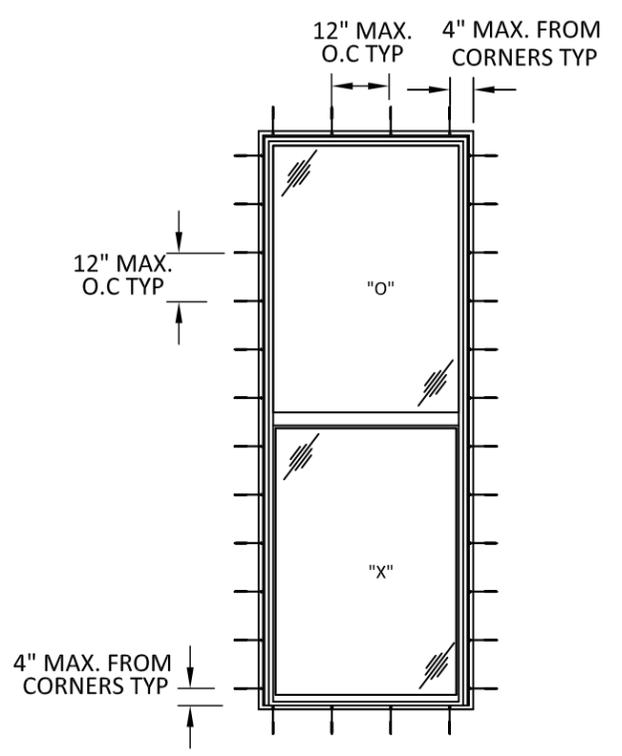

ANCHOR LAYOUT
SCREW OR CLIP INSTALLATION

s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg 12/22/2020 4:17 PM


TITLE: NEXT DIMENSION CLASSIC
SINGLE HUNG
(NON-HVHZ)(NON-IMPACT)
ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

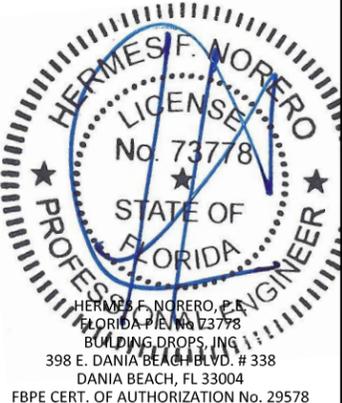

FL #: **FL14884**


DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET:

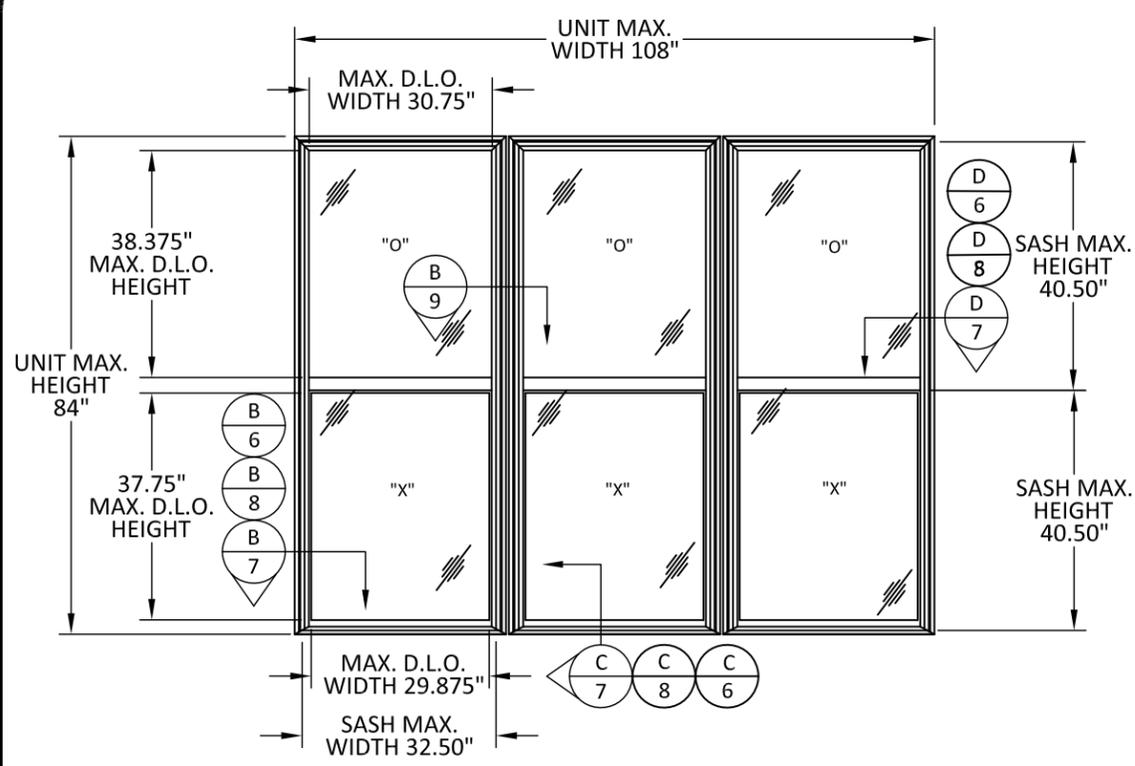

TYPICAL ELEVATION
NEXT DIMENSION CLASSIC 3-WIDE SINGLE HUNG

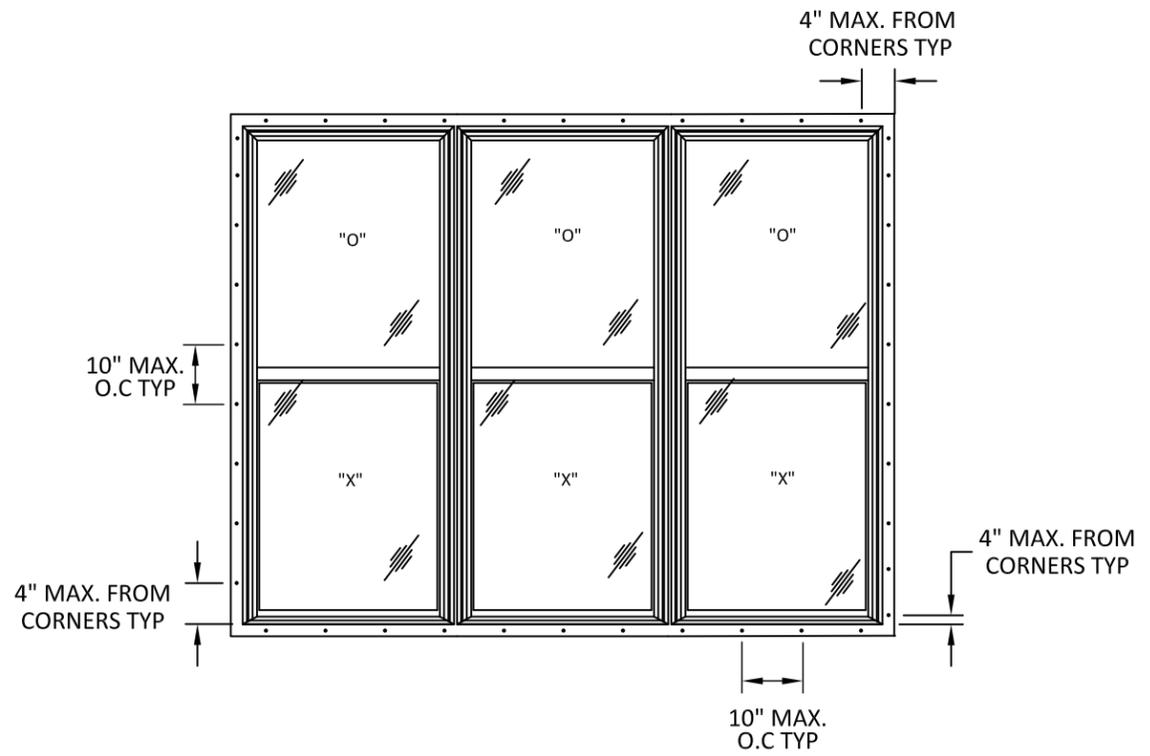

ANCHOR LAYOUT
NAIL FIN INSTALLATION

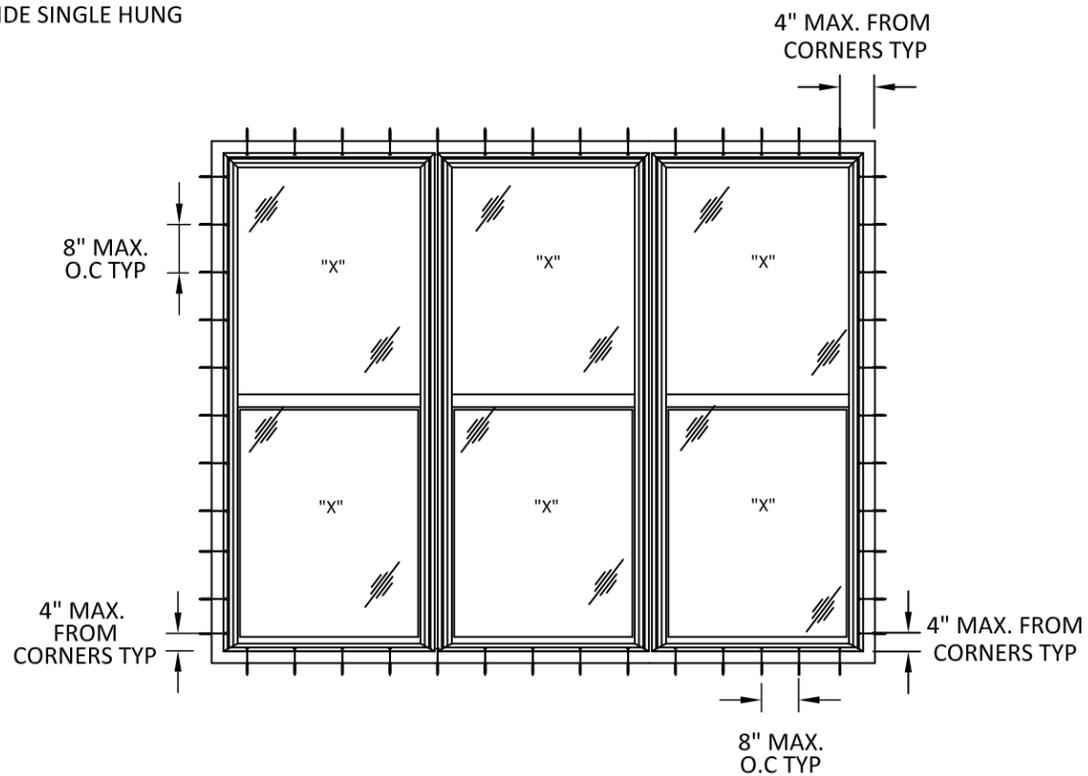

ANCHOR LAYOUT
SCREW OR CLIP INSTALLATION

12/22/2020 4:18 PM s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg


TITLE: NEXT DIMENSION CLASSIC
SINGLE HUNG
(NON-HVHZ)(NON-IMPACT)
ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

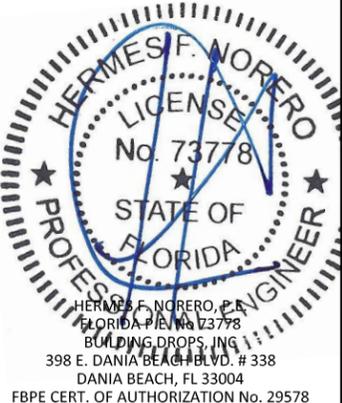

FL #: **FL14884**


DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET:

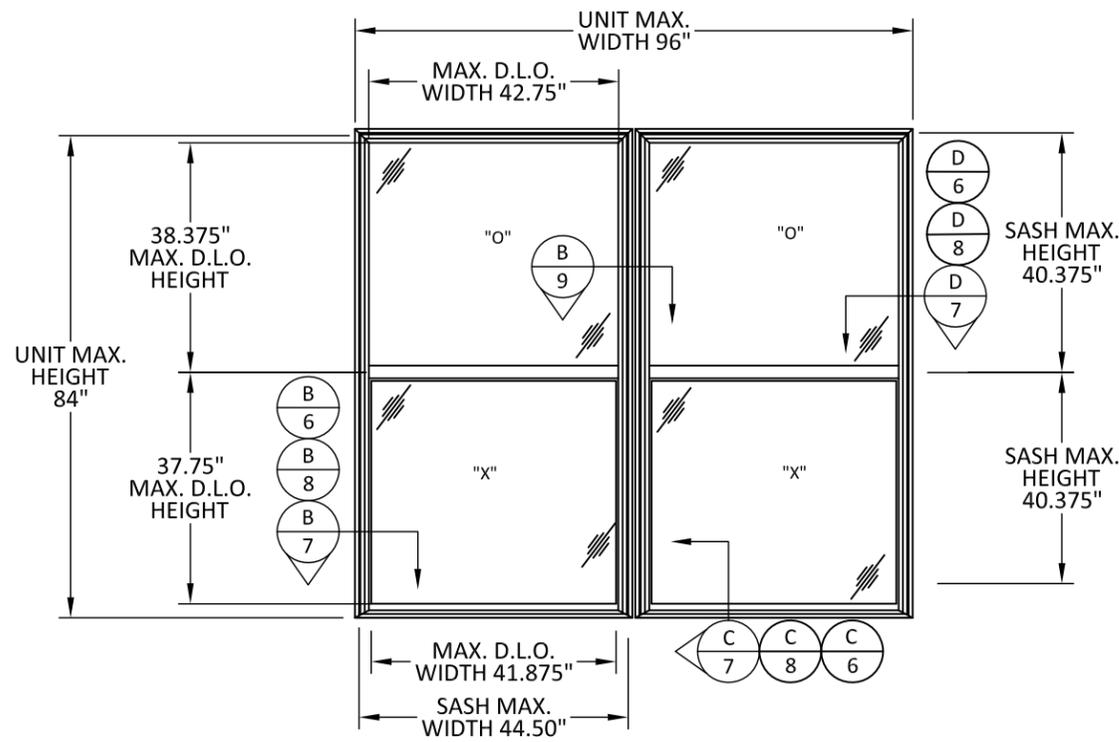

TYPICAL ELEVATION
NEXT DIMENSION CLASSIC 2-WIDE SINGLE HUNG

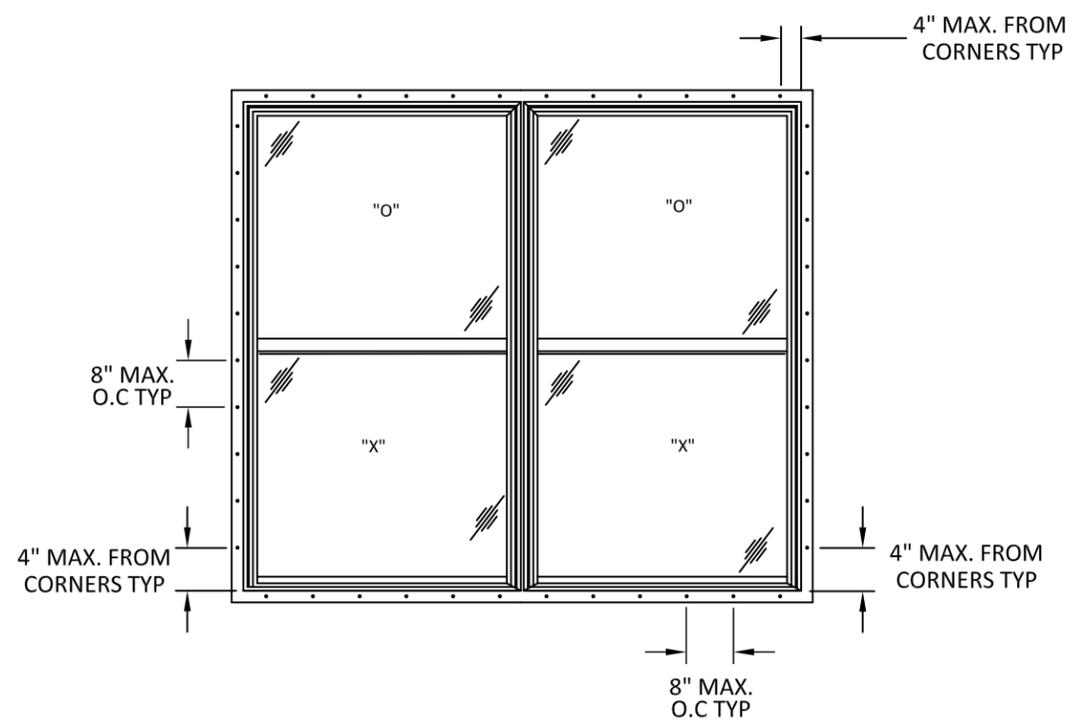

ANCHOR LAYOUT
NAIL FIN INSTALLATION

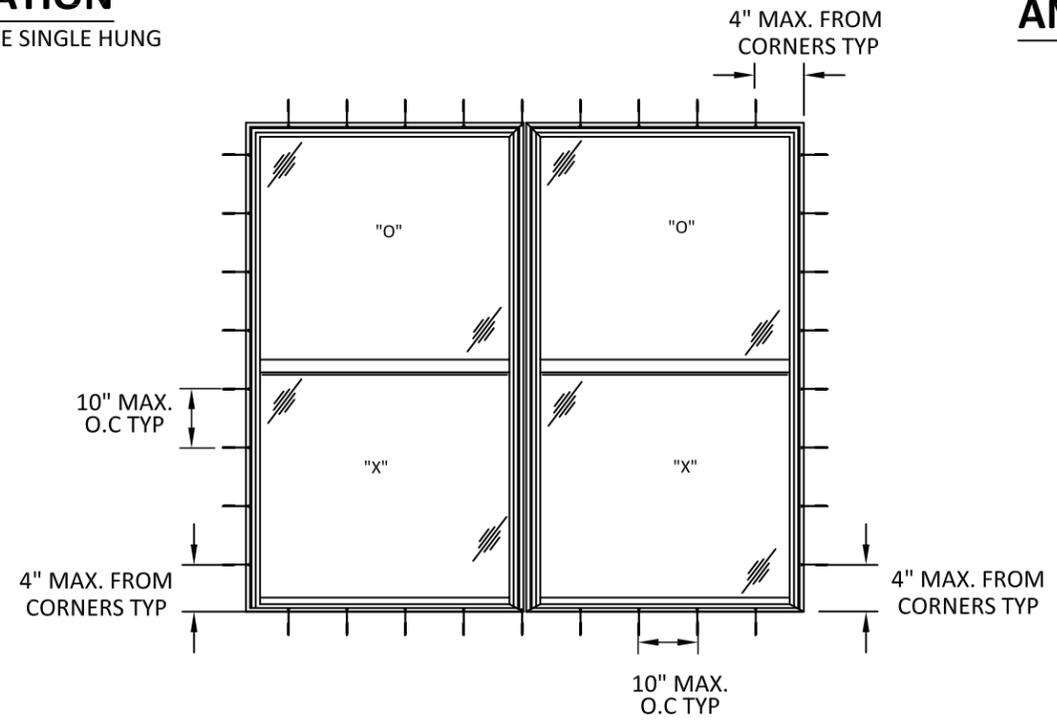

ANCHOR LAYOUT
SCREW OR CLIP INSTALLATION


12/22/2020 4:18 PM s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg

TITLE: NEXT DIMENSION CLASSIC
SINGLE HUNG
(NON-HVHZ)(NON-IMPACT)
NAIL FIN INSTALLATION
SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

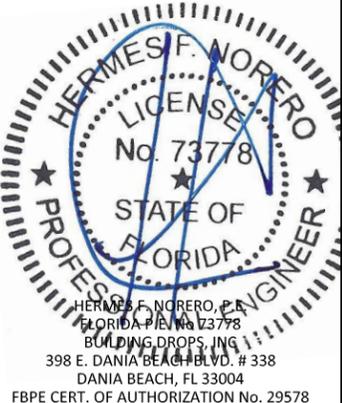

FL #: **FL14884**


DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET:

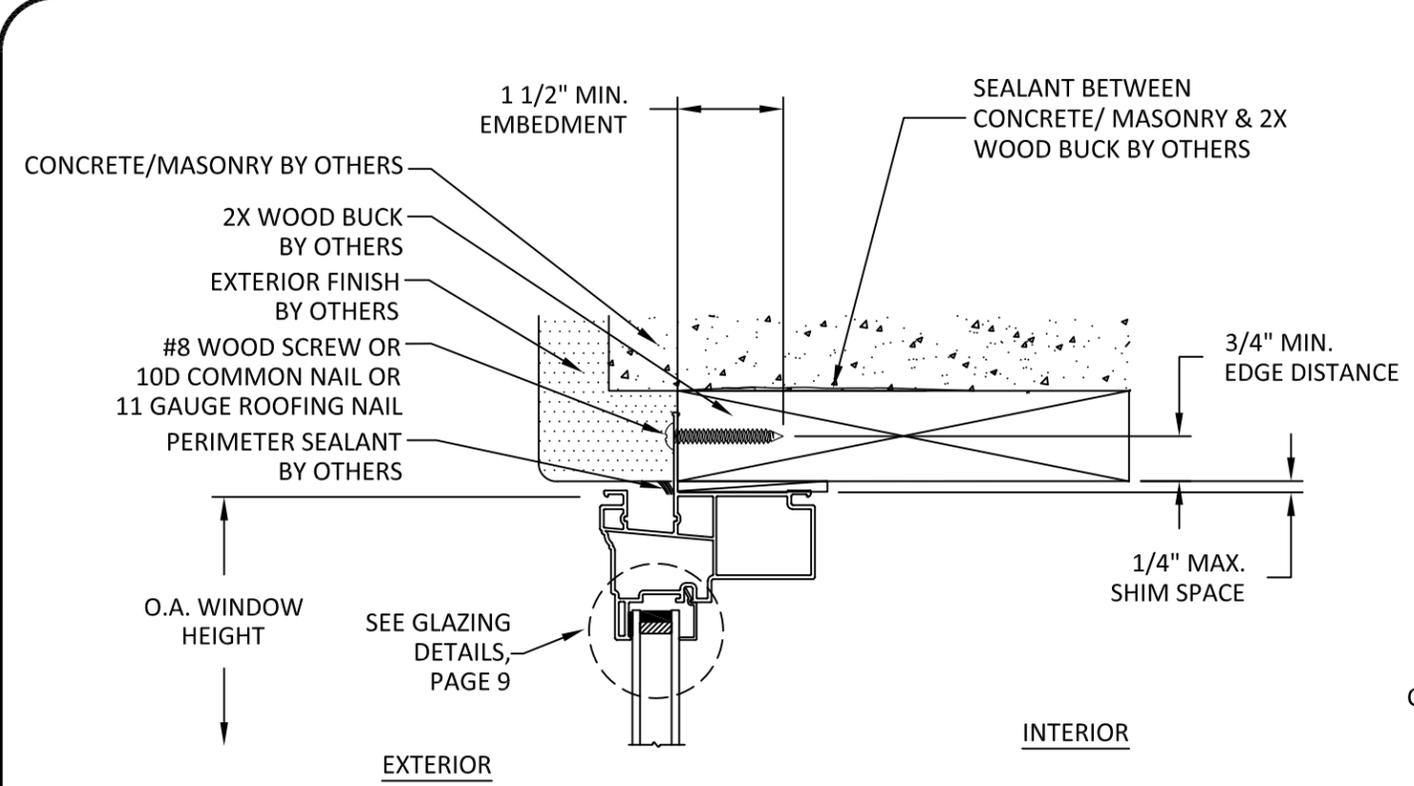


A
6 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK
NAIL FIN INSTALLATION

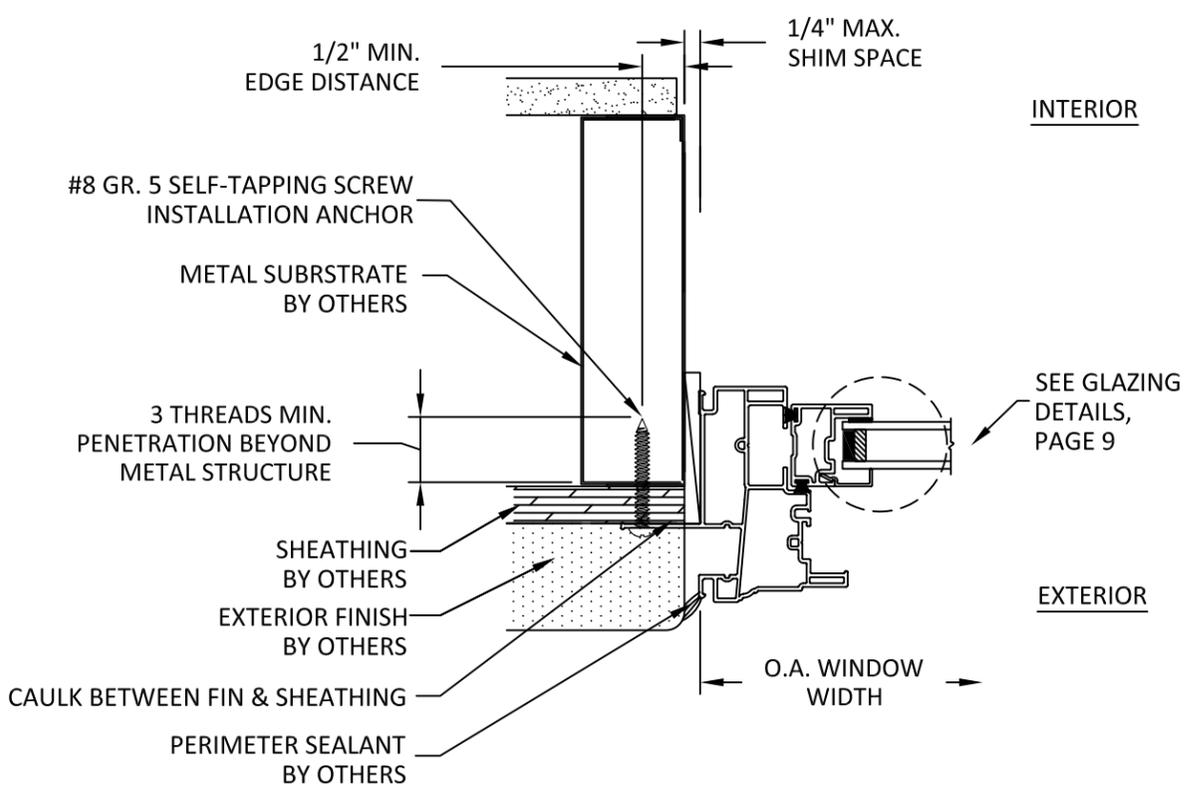

B
6 **HORIZONTAL SECTION**
JAMB - STEEL STUD FRAME
NAIL FIN INSTALLATION

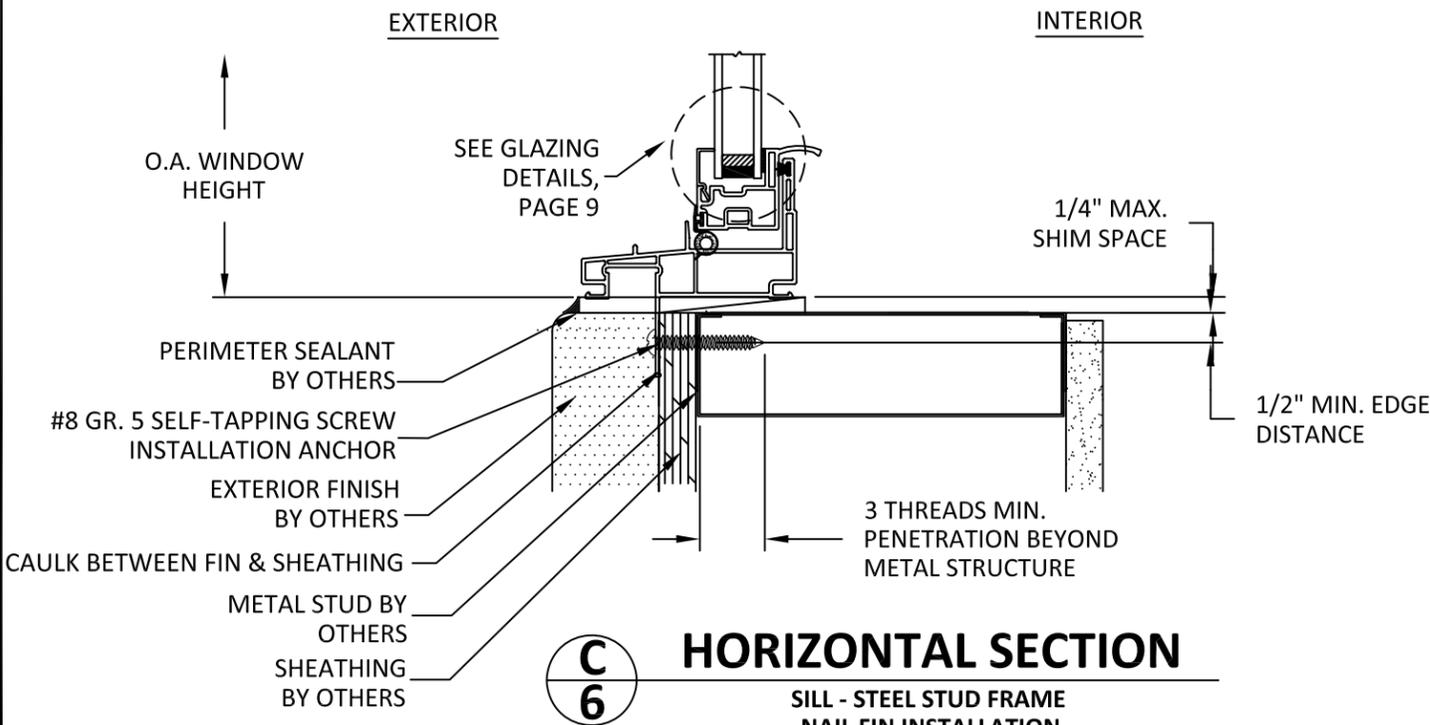

C
6 **HORIZONTAL SECTION**
SILL - STEEL STUD FRAME
NAIL FIN INSTALLATION

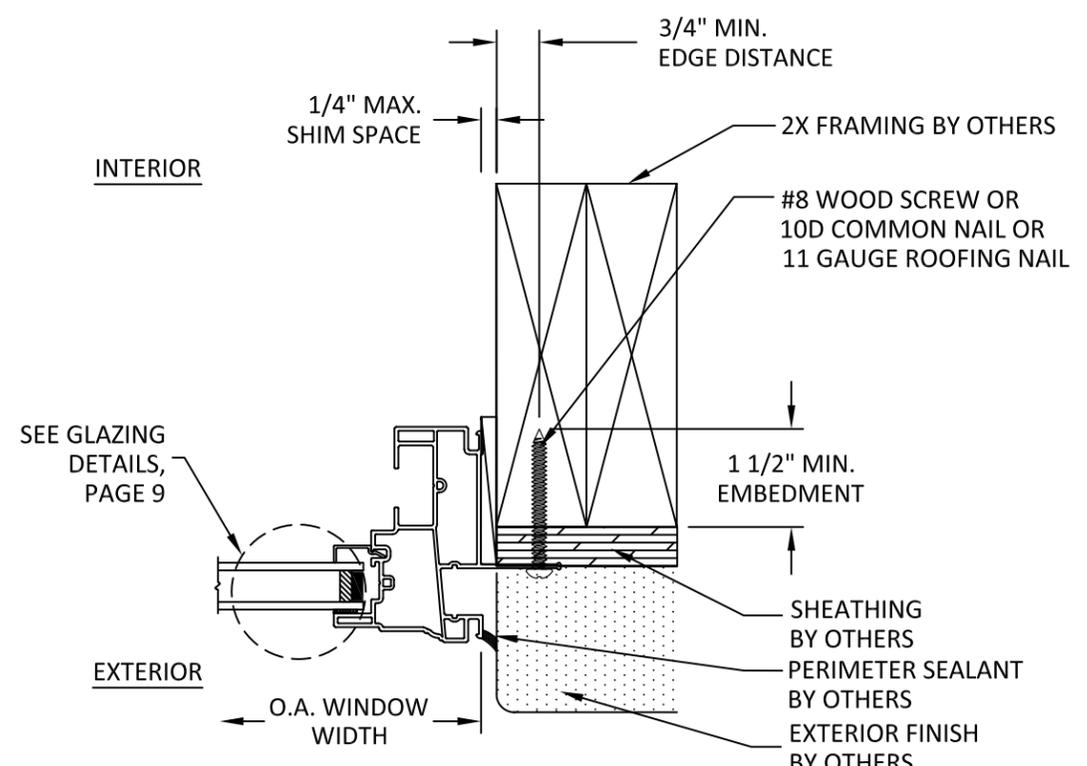

D
6 **HORIZONTAL SECTION**
JAMB - 2X FRAMING
NAIL FIN INSTALLATION


12/22/2020 4:18 PM
s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg

TITLE: NEXT DIMENSION CLASSIC
SINGLE HUNG
(NON-HVHZ)(NON-IMPACT)
THROUGH FRAME & CLIP INSTALLATION
SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)395-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

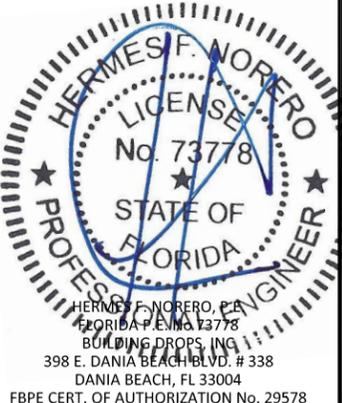

FL #:

FL14884


DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**

SHEET:

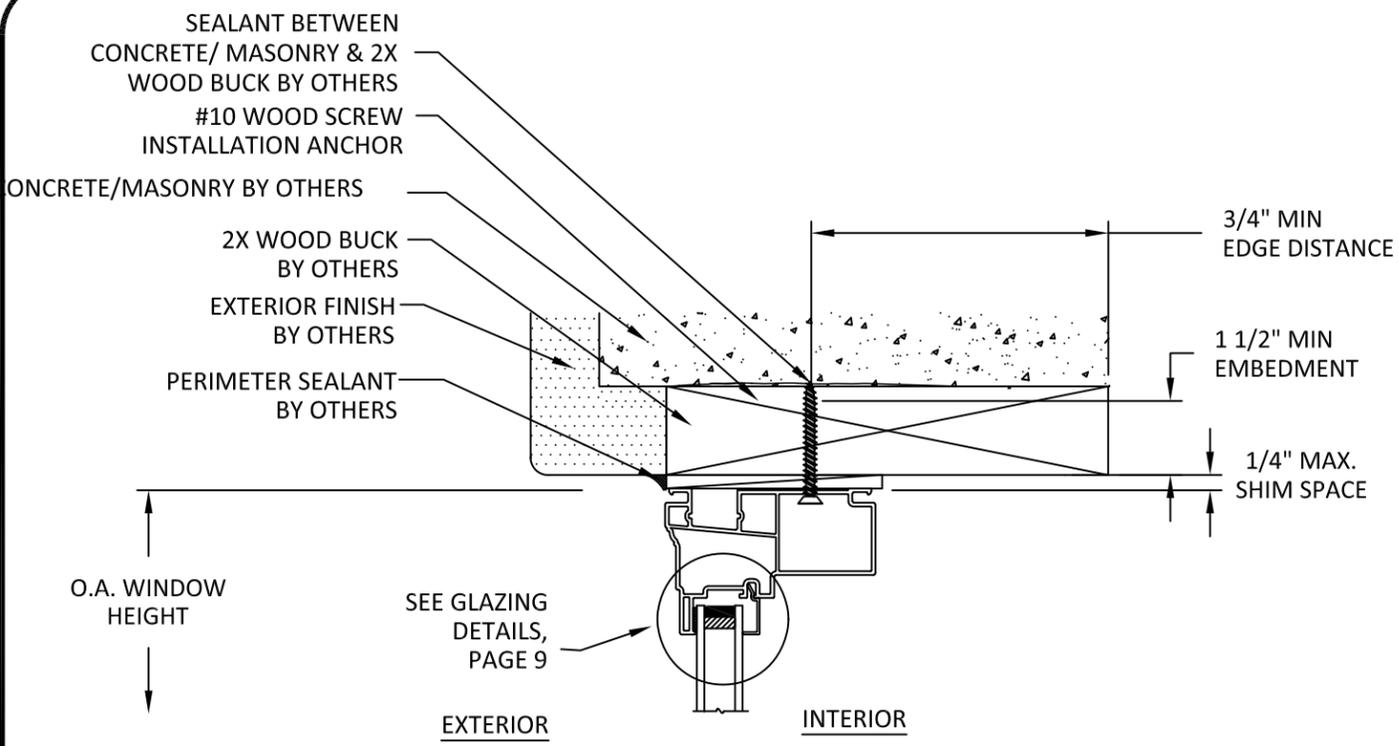


A
7
VERTICAL SECTION
HEAD - 2X WOOD BUCK
THROUGH FRAME INSTALLATION

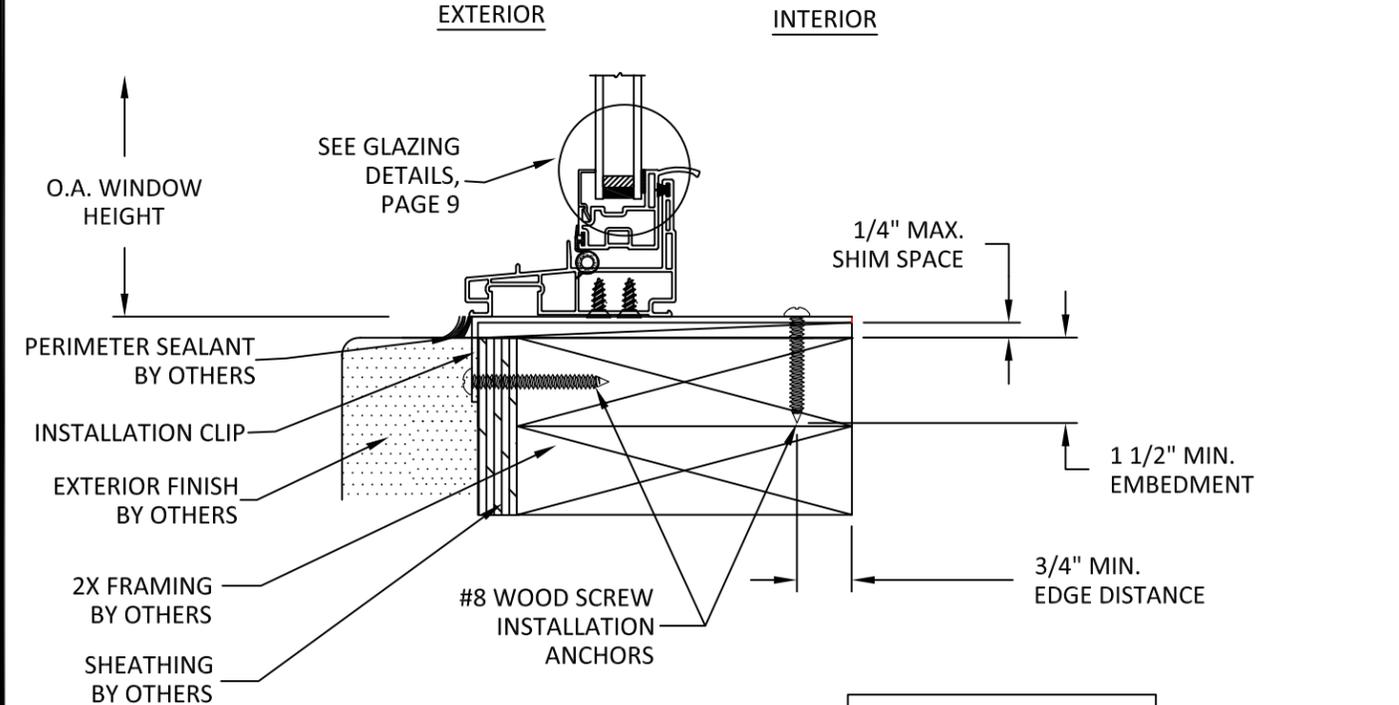


C
7
VERTICAL SECTION
SILL - 2X FRAMING
CLIP FRAME INSTALLATION

NOTE:
INSTALLATION AT SILL SHALL USE
CLIPS. THROUGH FRAME
INSTALLATION NOT PERMITTED.

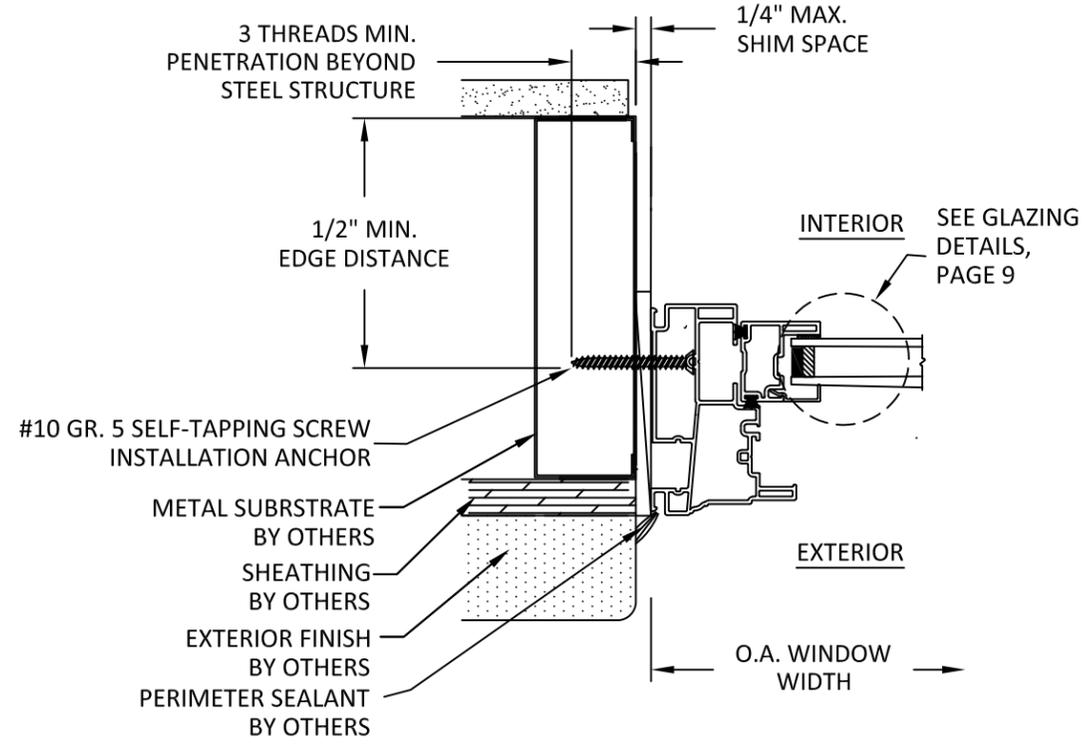

B
7
HORIZONTAL SECTION
JAMB - STEEL STUD FRAME
THROUGH FRAME INSTALLATION

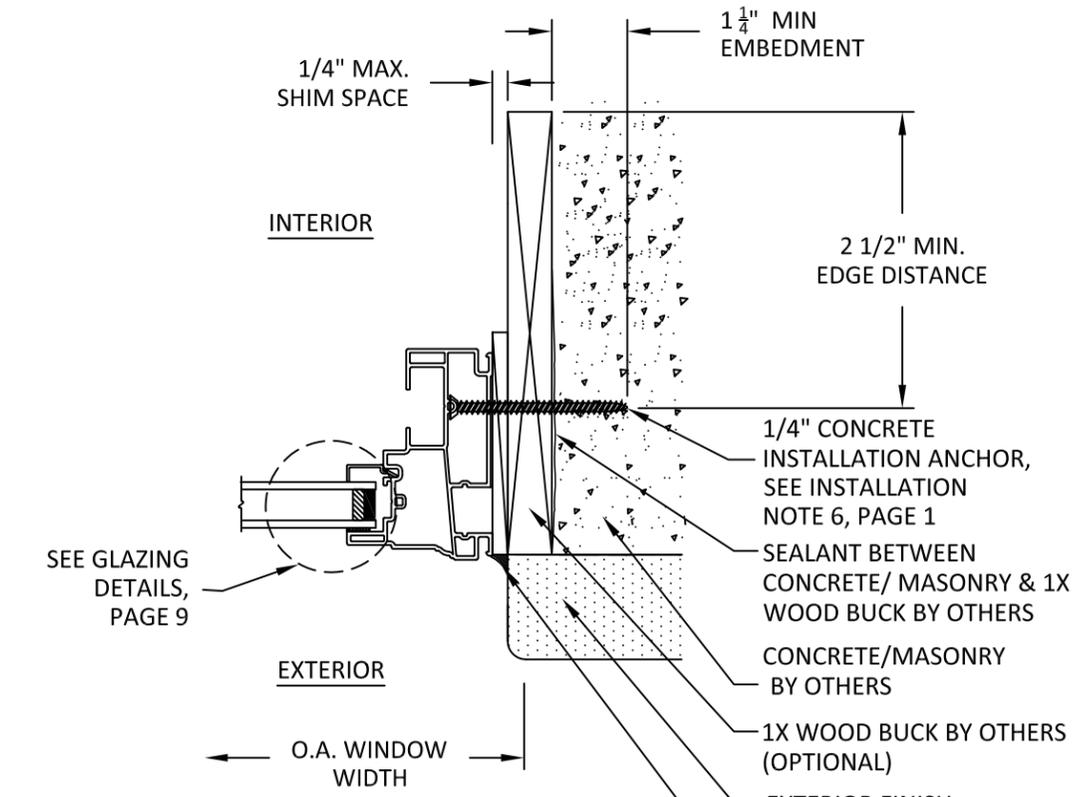

D
7
HORIZONTAL SECTION
JAMB - 1X BUCK TO CONCRETE/MASONRY
THROUGH FRAME INSTALLATION

s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg 12/22/2020 4:18 PM


TITLE: NEXT DIMENSION CLASSIC
SINGLE HUNG
(NON-HVHZ)(NON-IMPACT)
CLIP INSTALLATION SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

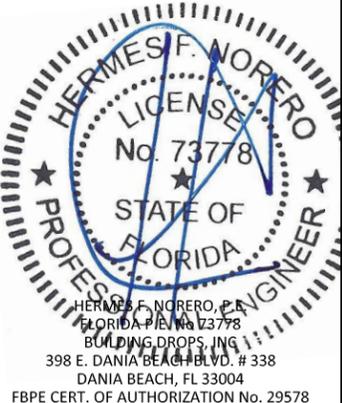

FL #: **FL14884**

DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWD058**


SHEET: **8**

12/22/2020 4:18 PM


s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg

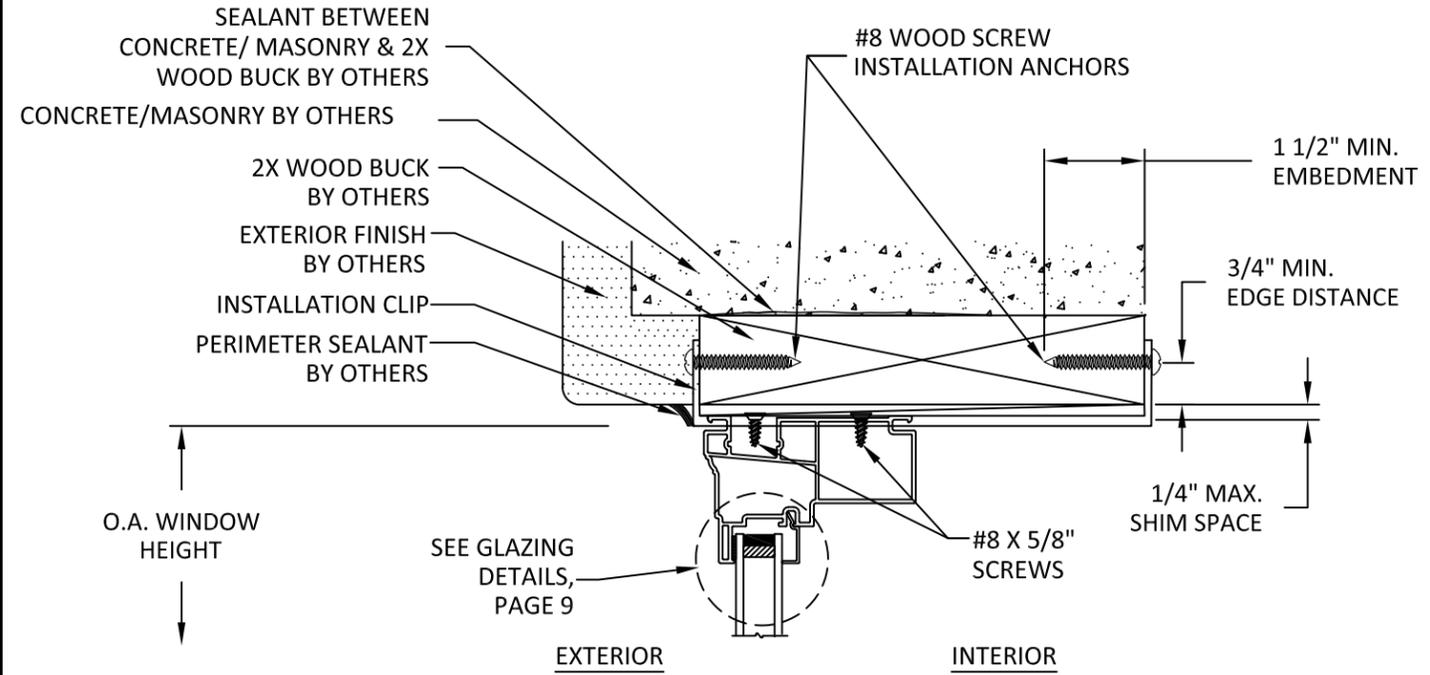


A
8 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK
STANDARD CLIP INSTALLATION

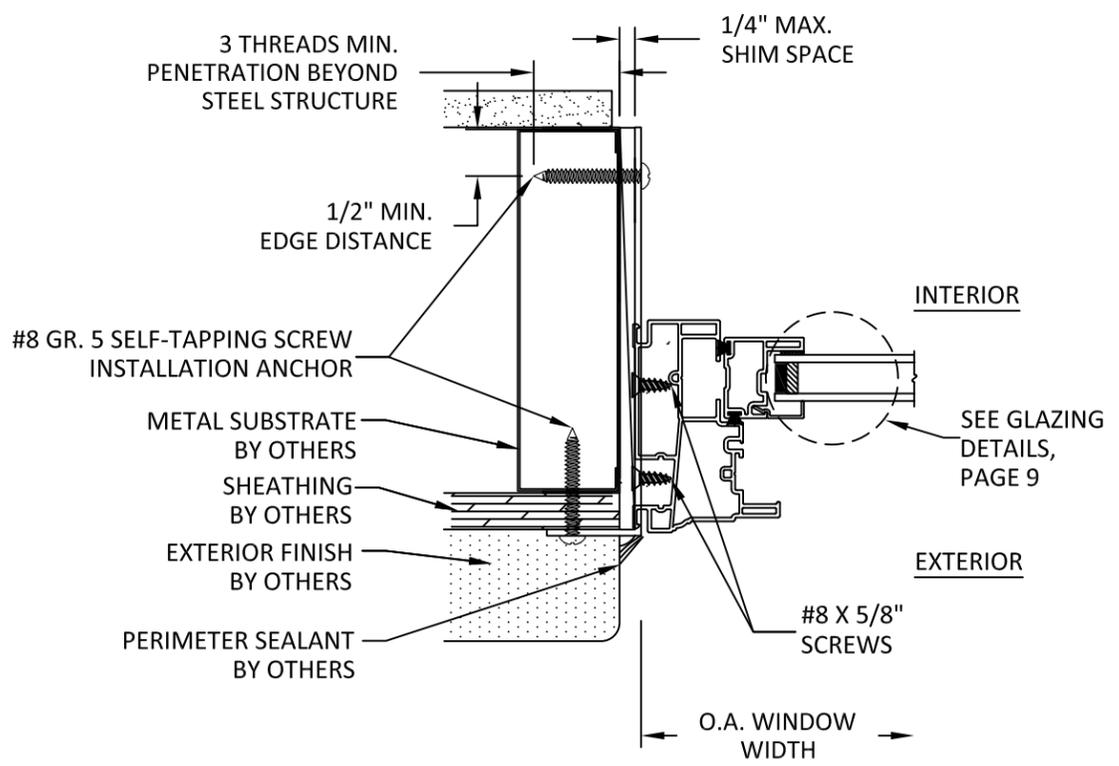

B
8 **HORIZONTAL SECTION**
JAMB - STEEL STUD FRAME
ALTERNATE CLIP INSTALLATION

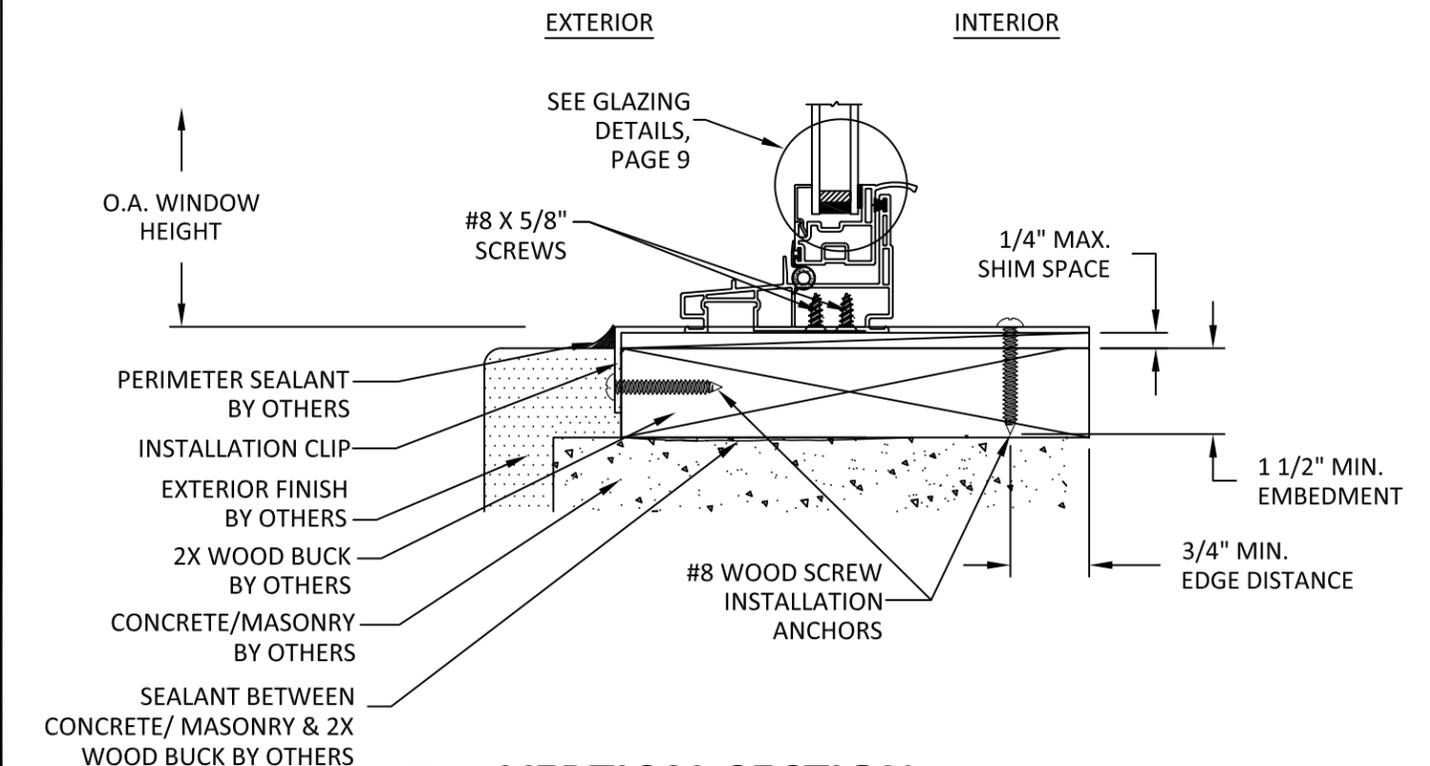


C
8 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
ALTERNATE CLIP INSTALLATION

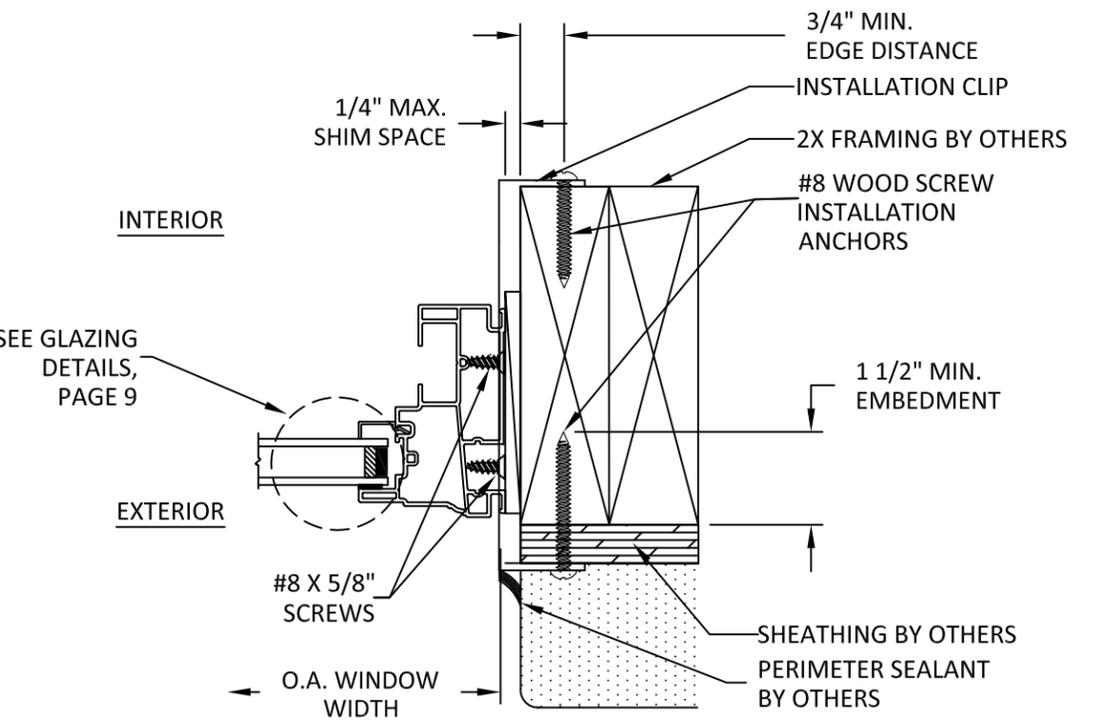


D
8 **HORIZONTAL SECTION**
JAMB - 2X FRAMING
STANDARD CLIP INSTALLATION

TITLE: NEXT DIMENSION CLASSIC SINGLE HUNG (NON-HVHZ)(NON-IMPACT) LOCK RAIL DETAIL, MULLION DETAIL, AND GLAZING DETAIL


PREPARED BY:  BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

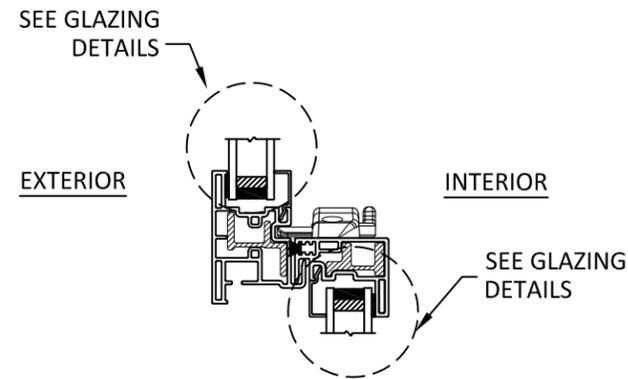

A
9 **LOCK RAIL**
SINGLE HUNG SWEEP LOCK

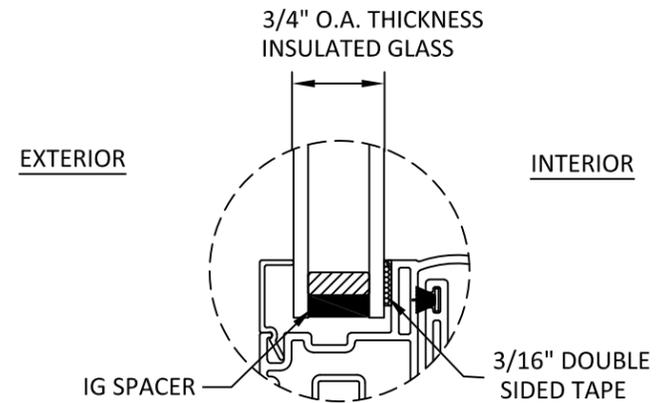

GLAZING DETAIL

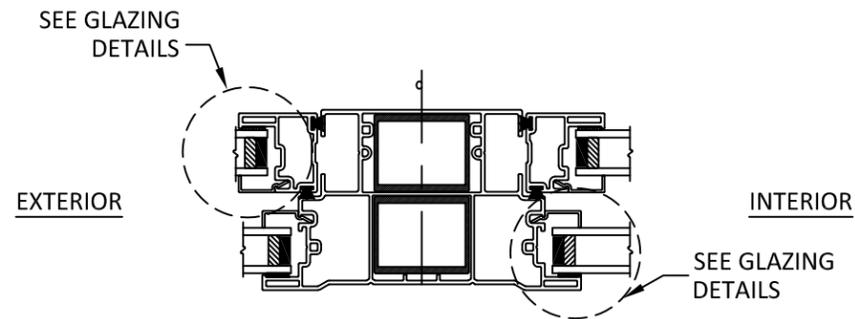


B
9 **VERTICAL MULLION**

- GLAZING NOTES:
- GLASS TYPE & THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE IBC/IRC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A).
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36".
 - DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLE ON SHEET 1.

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

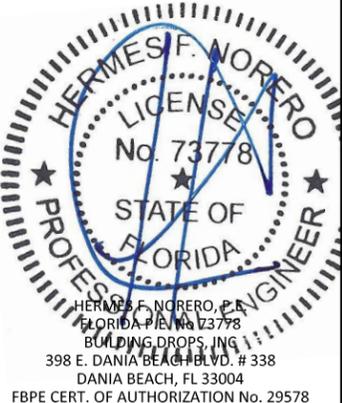

FL #: **FL14884**

DATE: **11.02.20**

DWG. BY: **NUS** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWD058**

SHEET:

s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\114884\wwd058.dwg 12/22/2020 4:18 PM