

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH BASED ON QUANTITIES IN DP CHARTS NOT TO EXCEED THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4" DIAMETER ITW TAPCONS, ELCO ULTRACONS, ELCO CRETE-FLEX OR HILTI KWIK-CON II OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
7. **THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #10 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. CLIPS SHALL BE FASTENED TO THE WINDOW FRAME WITH (2) #8 X 5/8" SCREWS. CLIPS ARE 20 GAUGE (0.063" THICKNESS) F_y=33 KSI MIN STEEL WITH OVERALL DIMENSIONS OF 1.5" WIDE, 7.813" ALONG THE LONG LEG, AND 1.942" ALONG THE SHORT LEG.
9. **CLIP ANCHOR:** FOR INSTALLATION INTO WOOD FRAMING USE (2) #8 WOOD SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
10. **CLIP ANCHOR:** FOR INSTALLATION INTO METAL STUD USE (2) #8 GR. 5 SELF-TAPPING SCREWS PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND THE METAL STRUCTURE.
11. 1.5" X 1.5" X 0.060" 6063-T5 ALUMINUM NAIL FIN SHALL BE FASTENED TO THE WINDOW FRAME WITH #8 X 1/2" SCREWS, 8" MAX. ON CENTER AND 4" MAX. FROM CORNERS, AND 3M VHB TAPE. THE 3M VHB TAPE IS ONLY USED TO HOLD THE DRIP CAP ON AT THE HEAD, IT IS NOT USED ON THE OTHER 3 SIDES OF THE NAIL FIN.
12. **NAIL FIN:** FOR INSTALLATION INTO WOOD FRAMING USE #8 WOOD SCREWS OR USE 10D COMMON NAIL OR 11 GAUGE ROOFING NAIL PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
13. **NAIL FIN:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #8 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
14. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
15. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
16. FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

WINDSOR WINDOWS & DOORS

NEXT DIMENSION SIGNATURE CASEMENT

(NON-HVHZ)(NON-IMPACT)

CONTINUED INSTALLATION NOTES:

17. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
- A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
- B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
- C. GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
- D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
- E. ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 1/8" (0.125").

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- AAMA/WDMA/CSA 101/I.S.2/A440-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: WOOD
8. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS, ANCHOR LAYOUTS
3	HORIZONTAL & VERTICAL SECTIONS NAIL FIN INSTALLATION
4	HORIZONTAL & VERTICAL SECTIONS THROUGH FRAME & CLIP INSTALLATION
5	HORIZONTAL & VERTICAL SECTIONS CLIP INSTALLATION
6	GLAZING DETAILS

DESIGN PRESSURE TABLE						
TYP. OVERALL SIZE		PRODUCT TYPE	DESIGN PRESSURE	CONFIGURATION	INSTALLATION METHOD	IMPACT RATING
WIDTH	HEIGHT					
35.50"	71.50"	VENT CASEMENT WINDOW	+50/-50 PSF	"X"	CLIP, THROUGH FRAME OR NAIL FIN	NON-IMPACT



WINDSOR WINDOWS & DOORS

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)

INSTALLATION
AND GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338

DANIA BEACH, FL 33004

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com




REMARKS

BY

DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

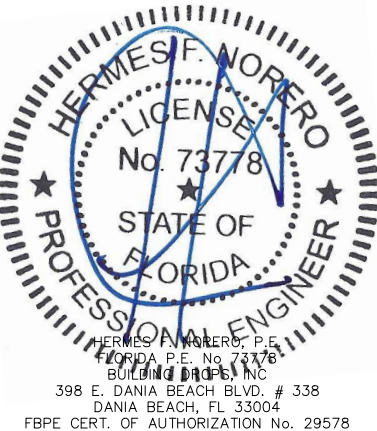

FL #:

FL17785

DATE: 11.13.2020

DWG. BY:
NUS

CHK. BY:
HFN

SCALE: NTS


DWG. #: WWD062

SHEET:


1

OF 6


s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\117785\wwd062.dwg 12/23/2020 3:31 PM

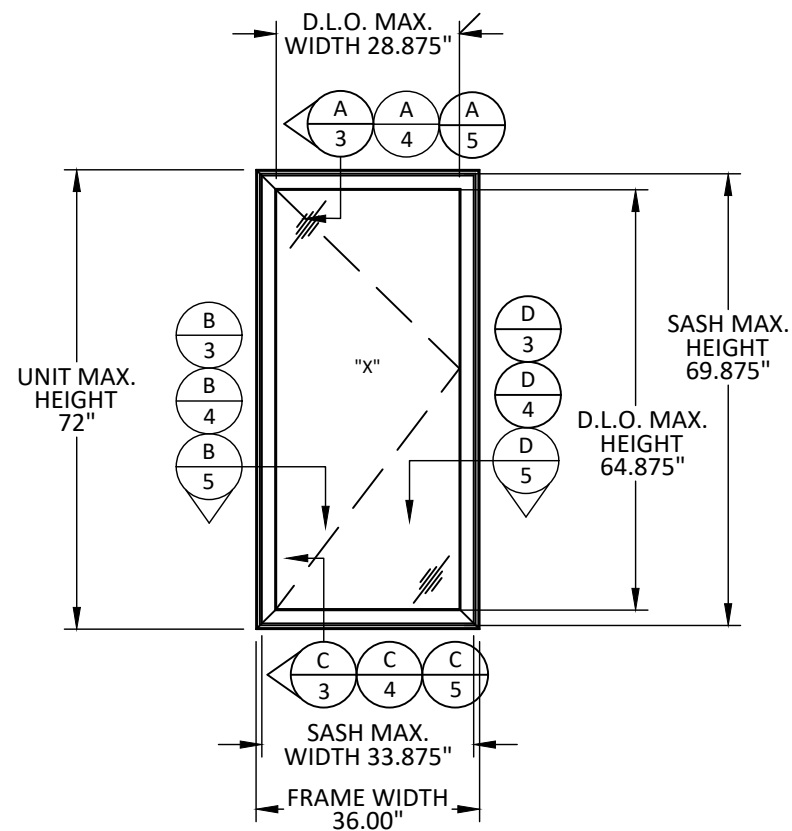

TYPICAL ELEVATION
CASEMENT

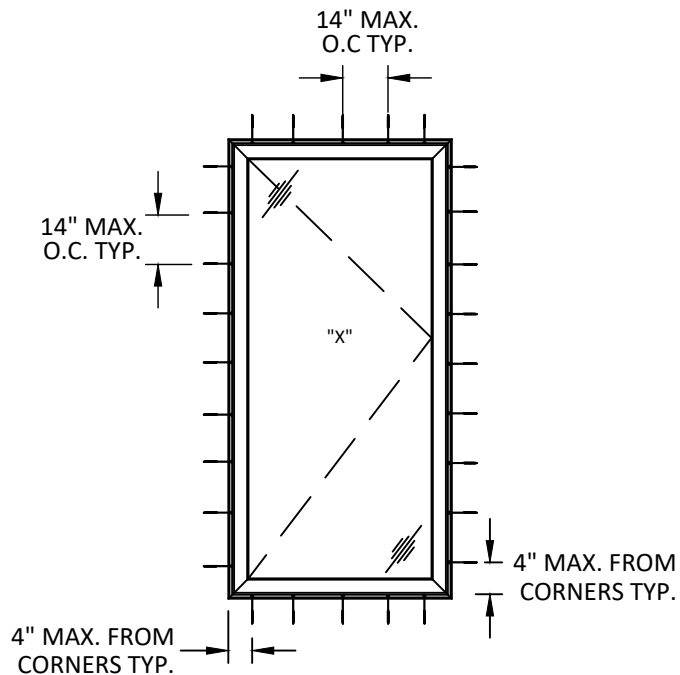

ANCHOR LAYOUT
CLIP OR THROUGH FRAME INSTALLATION

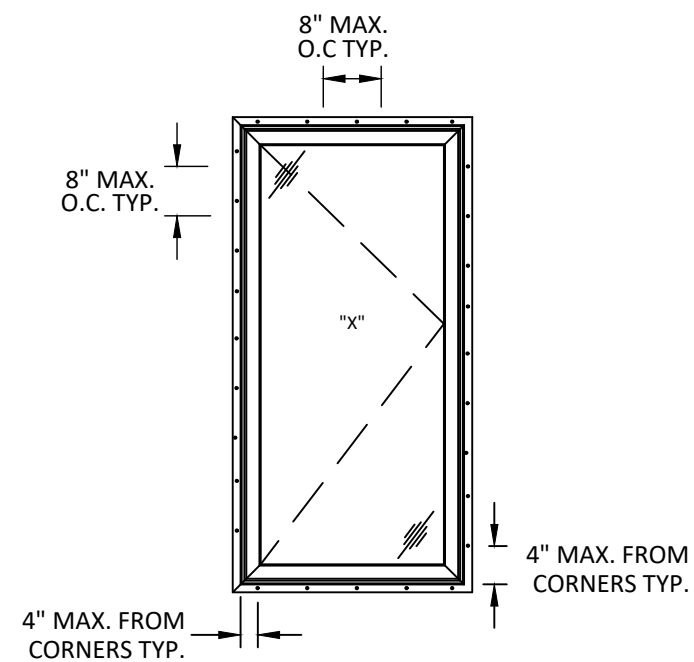

ANCHOR LAYOUT
NAIL FIN INSTALLATION



**WINDSOR WINDOWS
& DOORS**

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE: NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)

ELEVATIONS, & ANCHOR LAYOUT


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

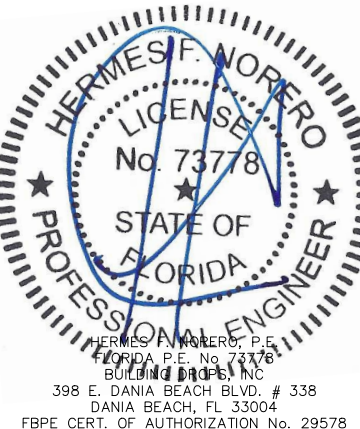

FL #: **FL17785**

DATE: **11.13.2020**


DWG. BY: **NUS** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WWD062**

SHEET:


12/23/2020 3:31 PM
s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\117785\wwd062.dwg

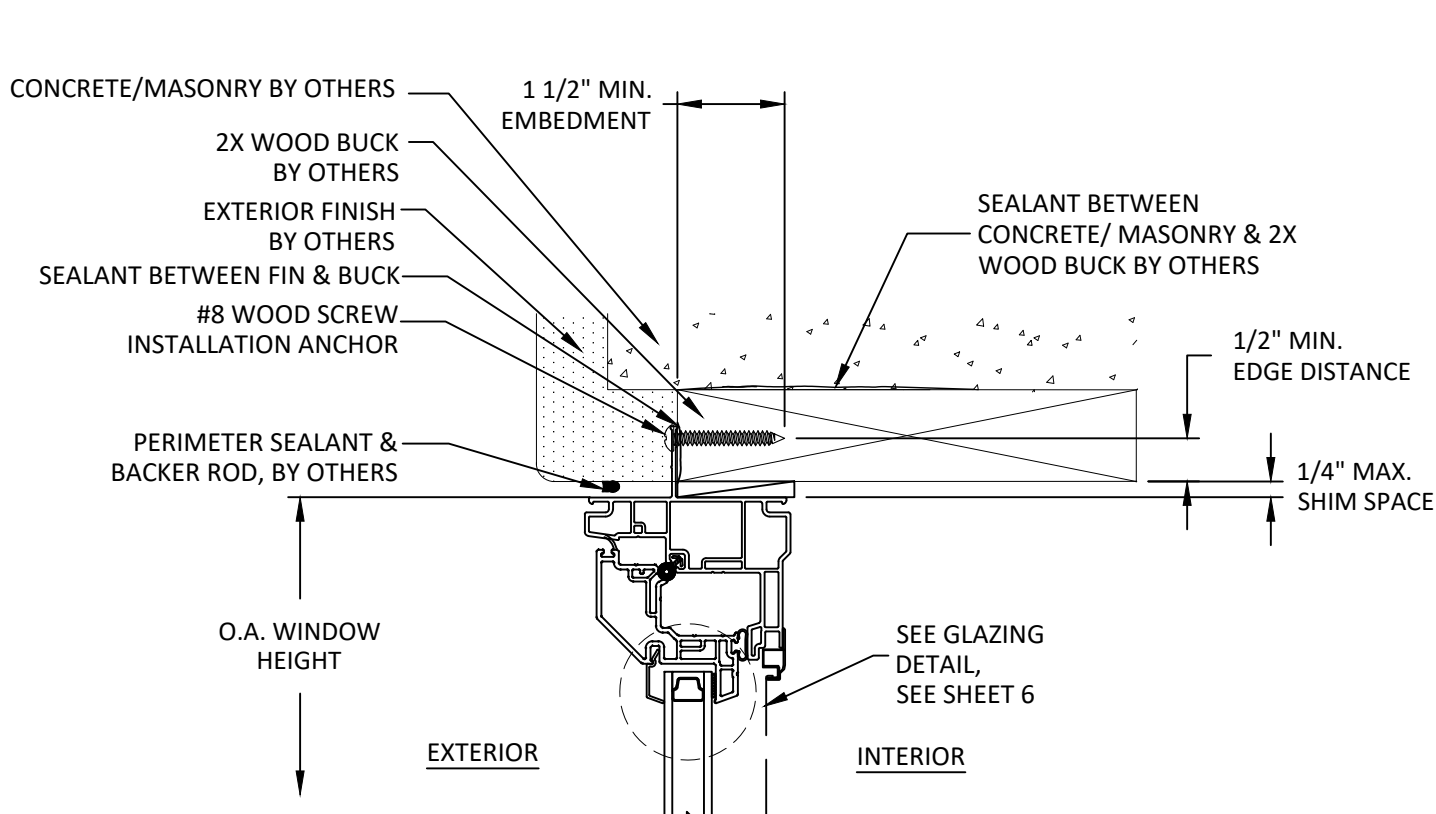


A
3
VERTICAL SECTION
HEAD - 2X WOOD BUCK
NAIL FIN INSTALLATION

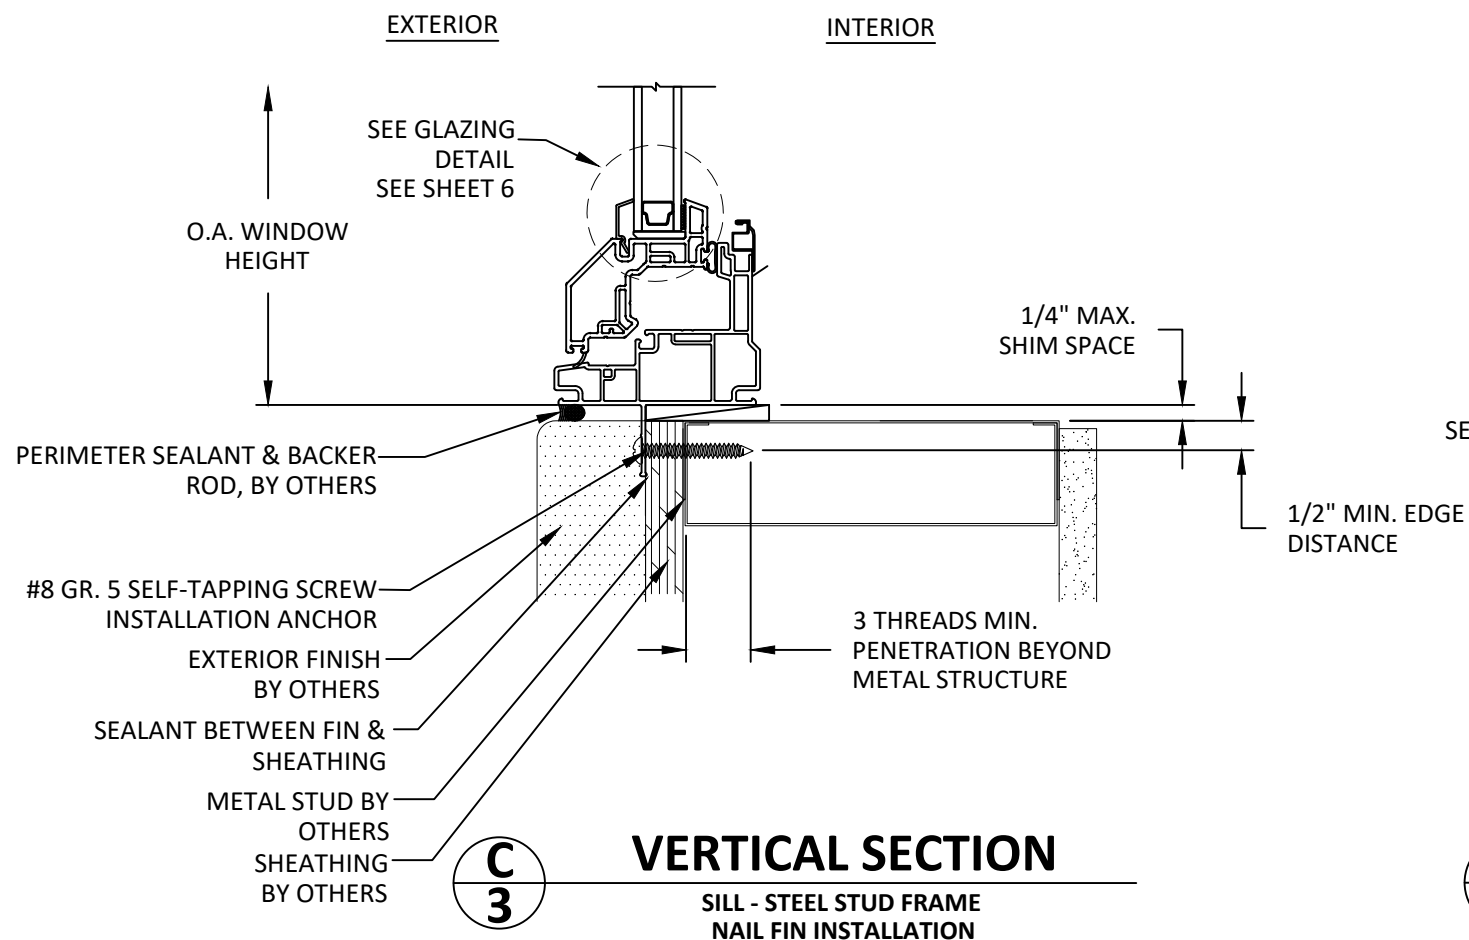

C
3
VERTICAL SECTION
SILL - STEEL STUD FRAME
NAIL FIN INSTALLATION

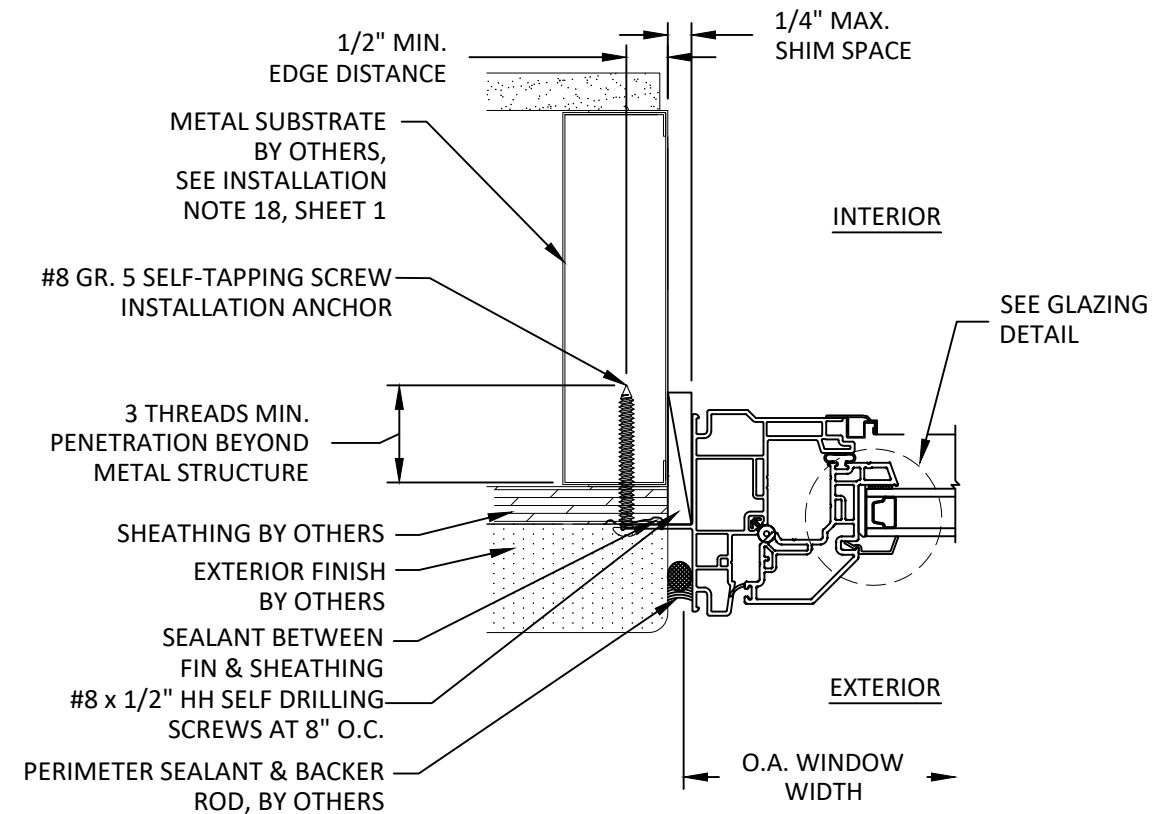

B
3
HORIZONTAL SECTION
JAMB - METAL FRAME
NAIL FIN INSTALLATION

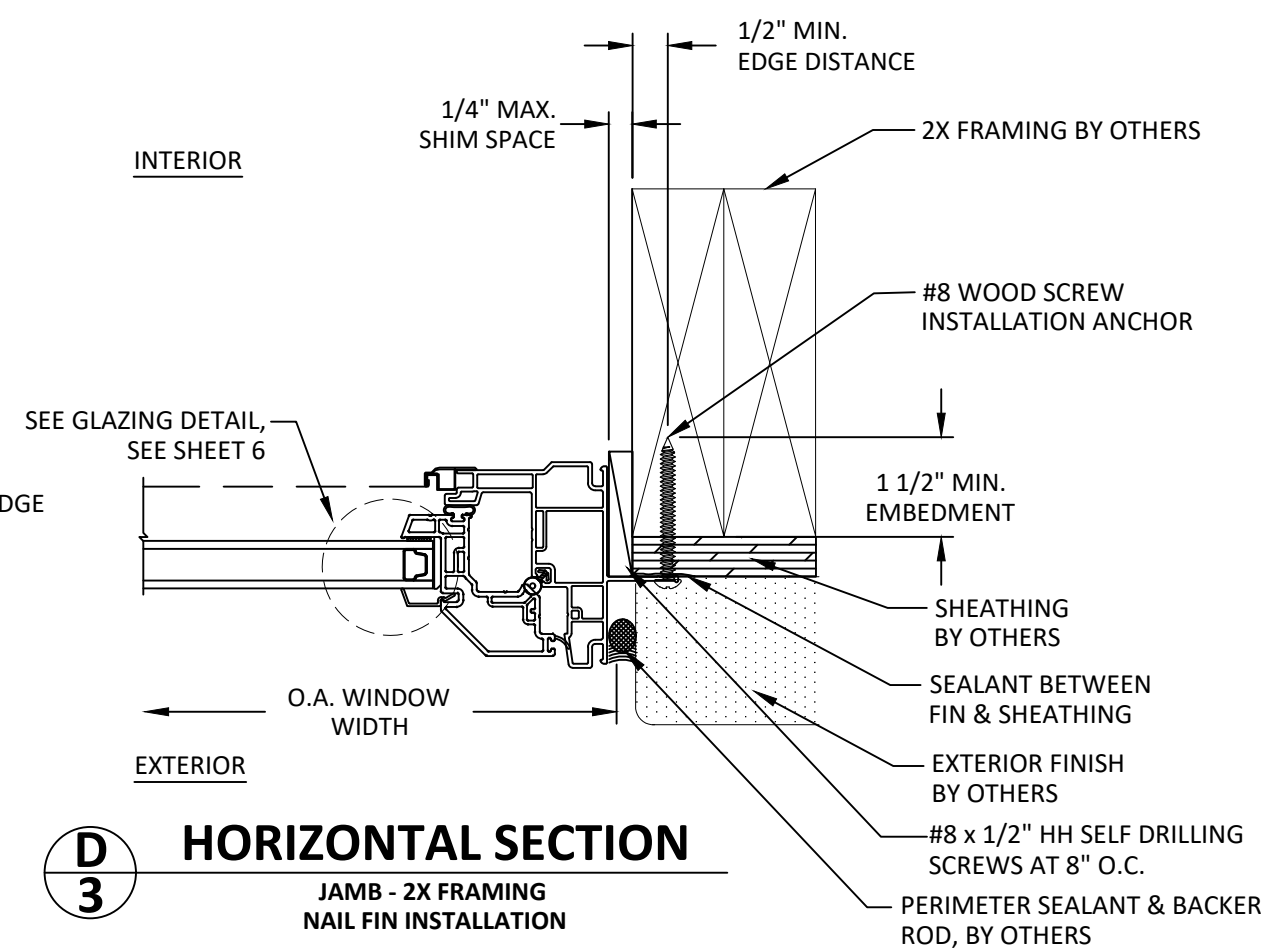

D
3
HORIZONTAL SECTION
JAMB - 2X FRAMING
NAIL FIN INSTALLATION




WINDSOR WINDOWS & DOORS
900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE: NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)
HORIZONTAL & VERTICAL SECTIONS
NAIL FIN INSTALLATION
PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

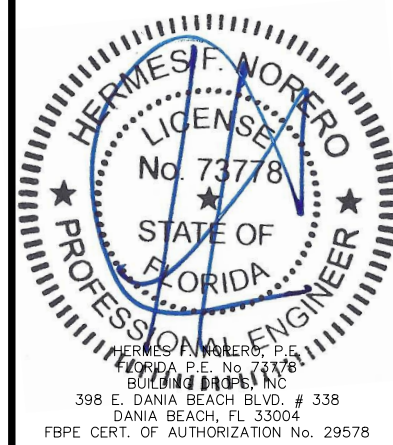


FL #: **FL17785**
DATE: **11.13.2020**
DWG. BY: **NUS** CHK. BY: **HFN**
SCALE: **NTS**
DWG. #: **WWD062**
SHEET:

12/23/2020 3:31 PM


s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwg\117785\wwd062.dwg

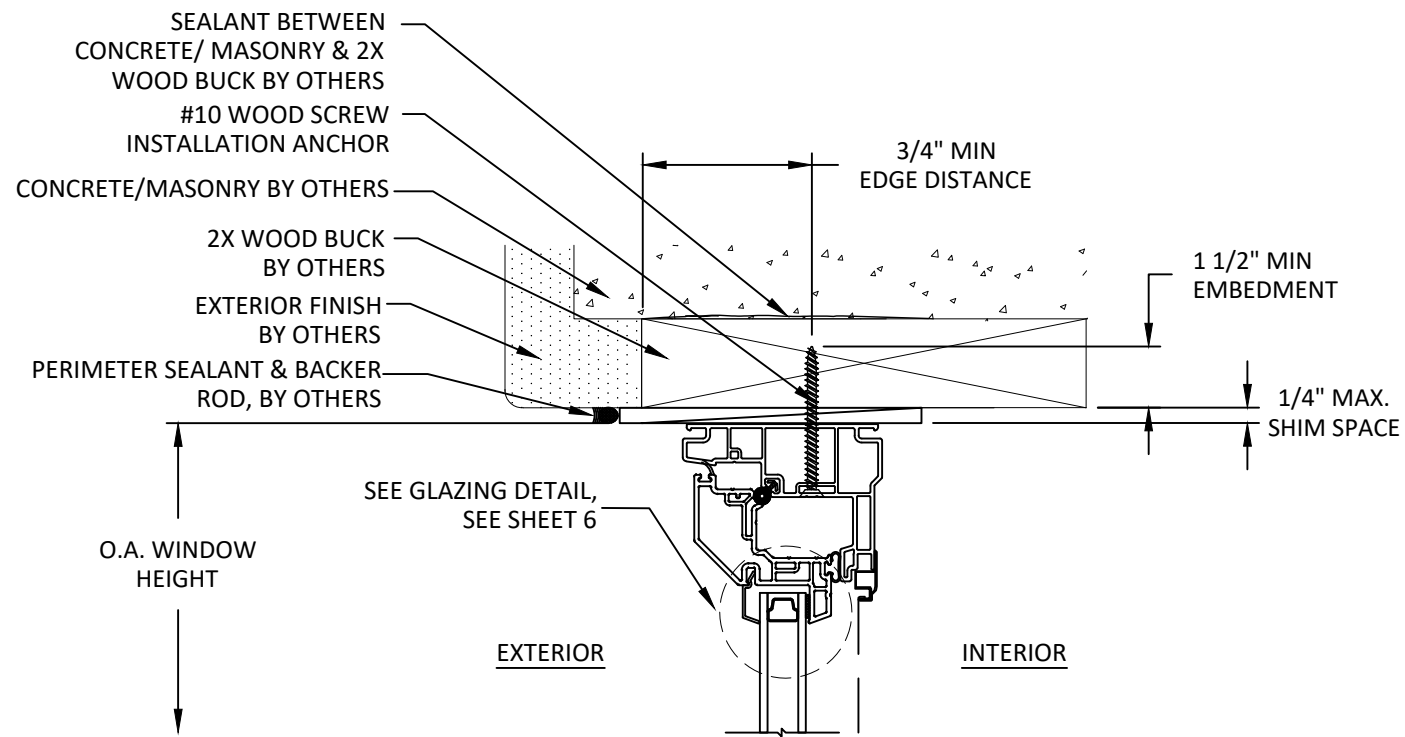


A
4 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK
THROUGH FRAME INSTALLATION

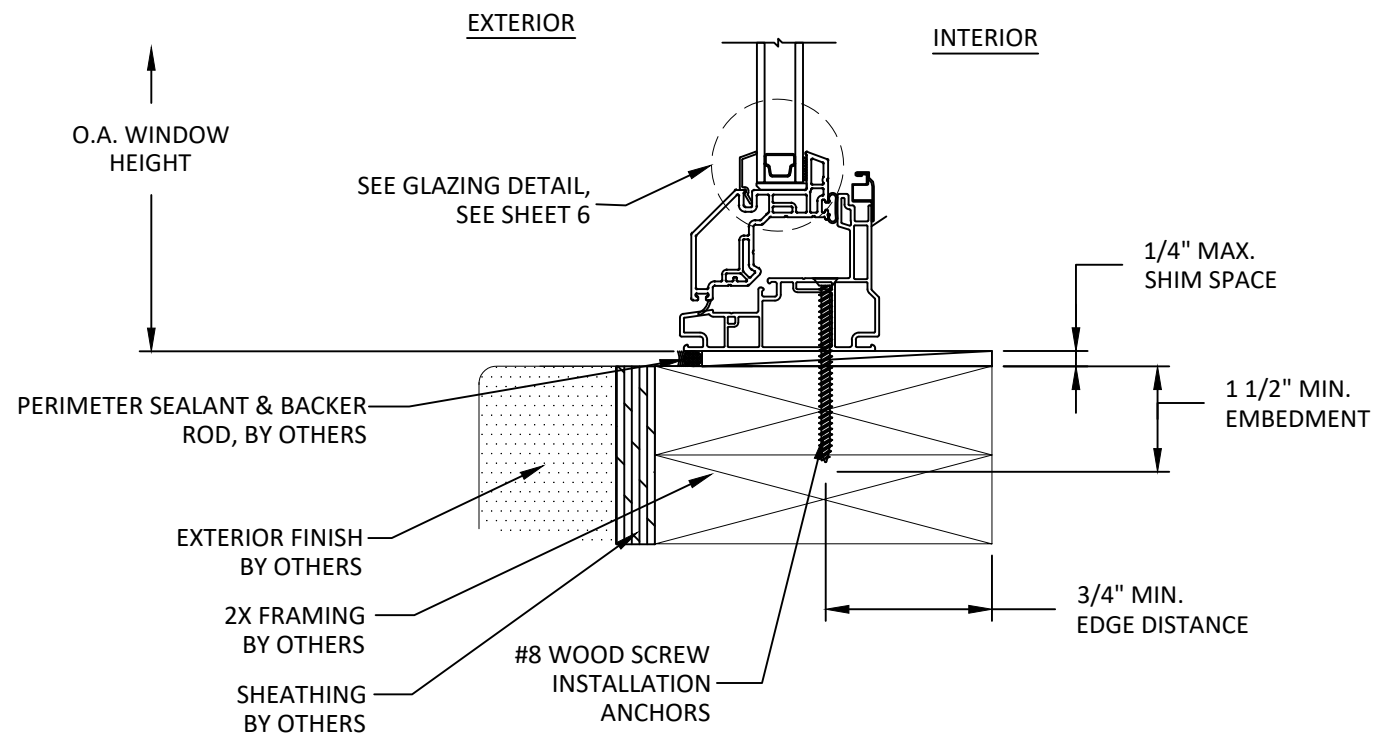

C
4 **VERTICAL SECTION**
SILL - 2X FRAMING
THROUGH FRAME INSTALLATION

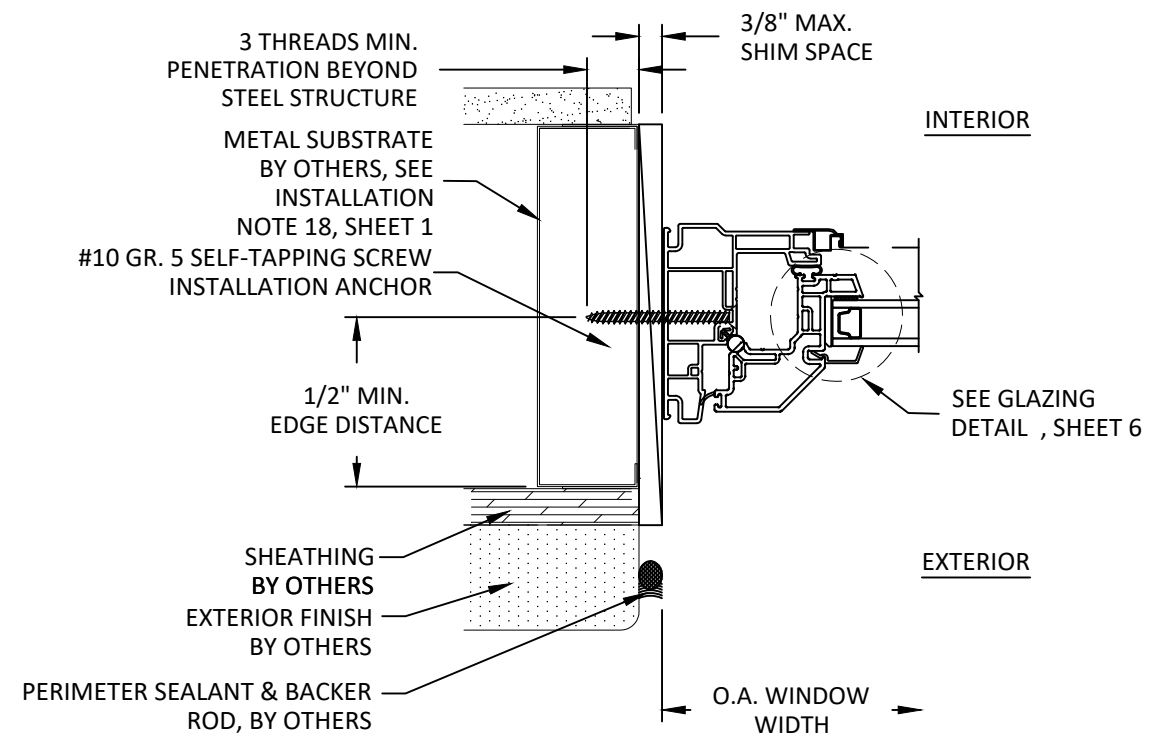

B
4 **HORIZONTAL SECTION**
JAMB - METAL STUD FRAME
THROUGH FRAME INSTALLATION

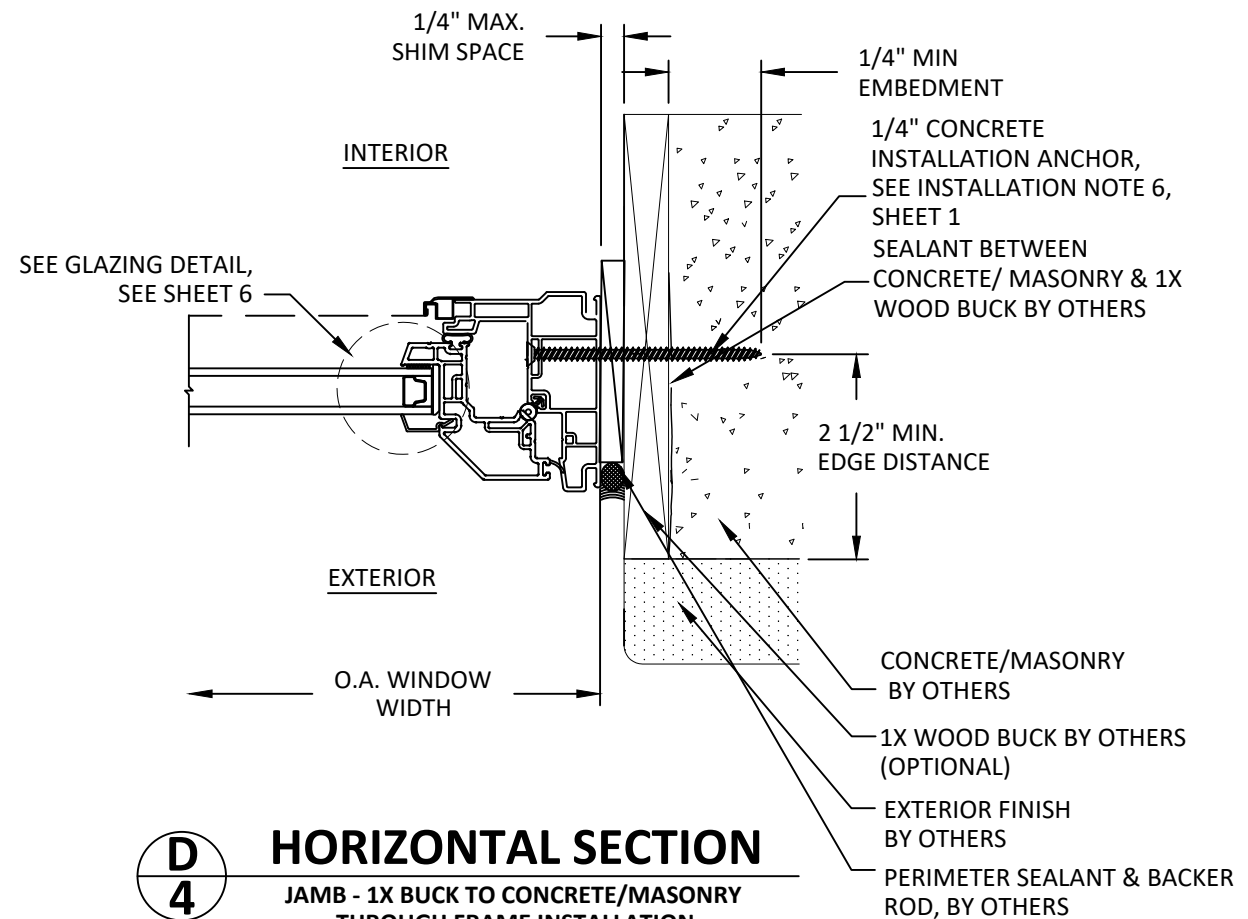

D
4 **HORIZONTAL SECTION**
JAMB - 1X BUCK TO CONCRETE/MASONRY
THROUGH FRAME INSTALLATION



**WINDSOR WINDOWS
& DOORS**

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)

HORIZONTAL & VERTICAL SECTIONS
THROUGH FRAME & CLIP INSTALLATION


PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

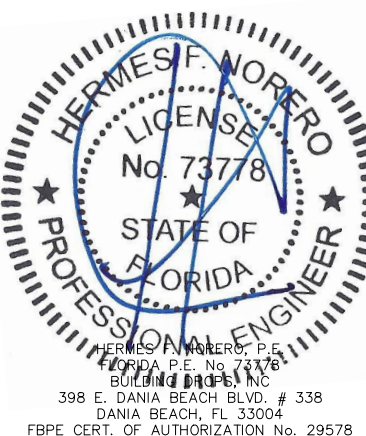

FL #:
FL17785

DATE: **11.13.2020**

DWG. BY: **NUS** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WWD062**

SHEET:


4

12/23/2020 3:31 PM


s:\projects\windsor windows and doors\cc-20-0917-bc code change (ver. 7)\dwgs\117785\wwd062.dwg

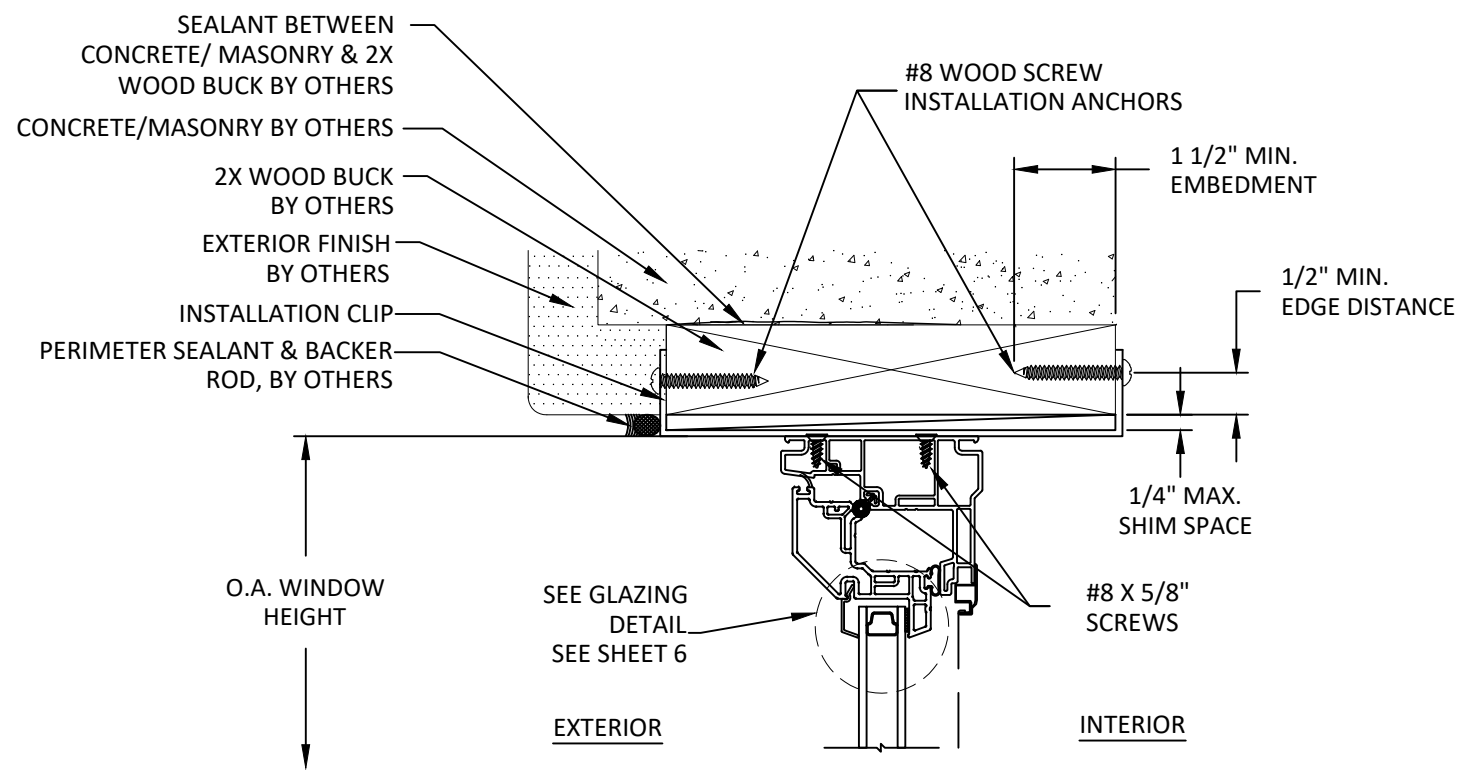


A
5 VERTICAL SECTION
HEAD - 2X WOOD BUCK
STANDARD CLIP INSTALLATION

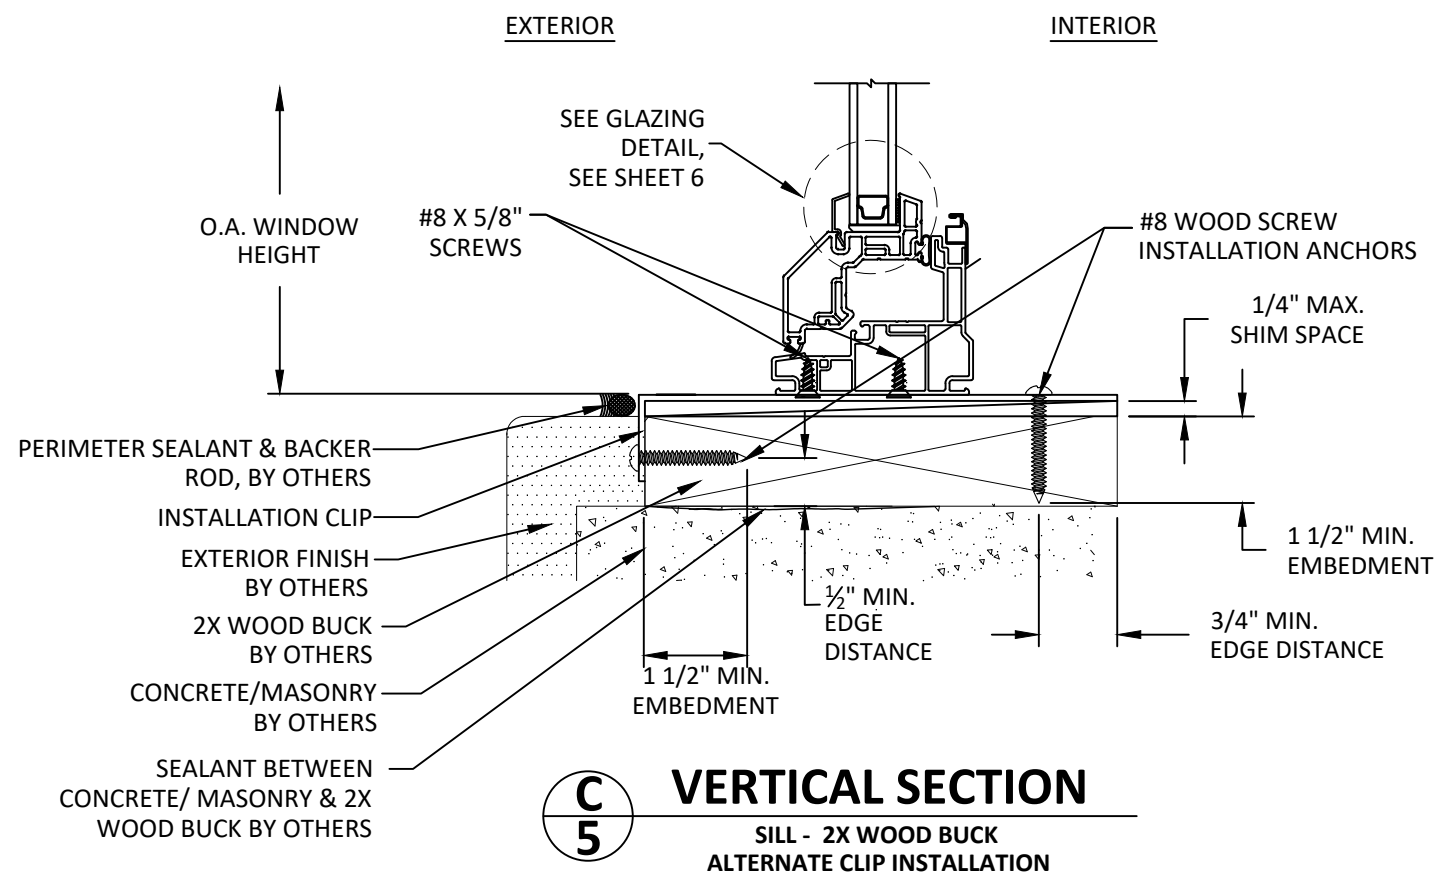

C
5 VERTICAL SECTION
SILL - 2X WOOD BUCK
ALTERNATE CLIP INSTALLATION

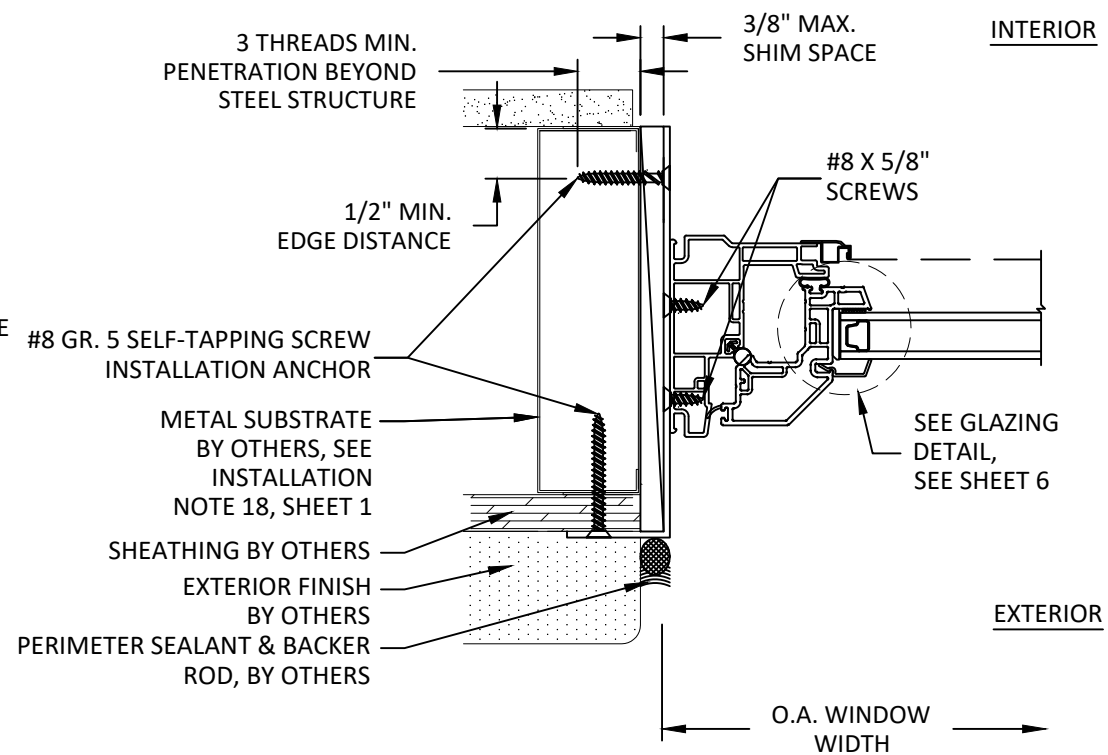

B
5 HORIZONTAL SECTION
JAMB - METAL SUBSTRATE
ALTERNATE CLIP INSTALLATION

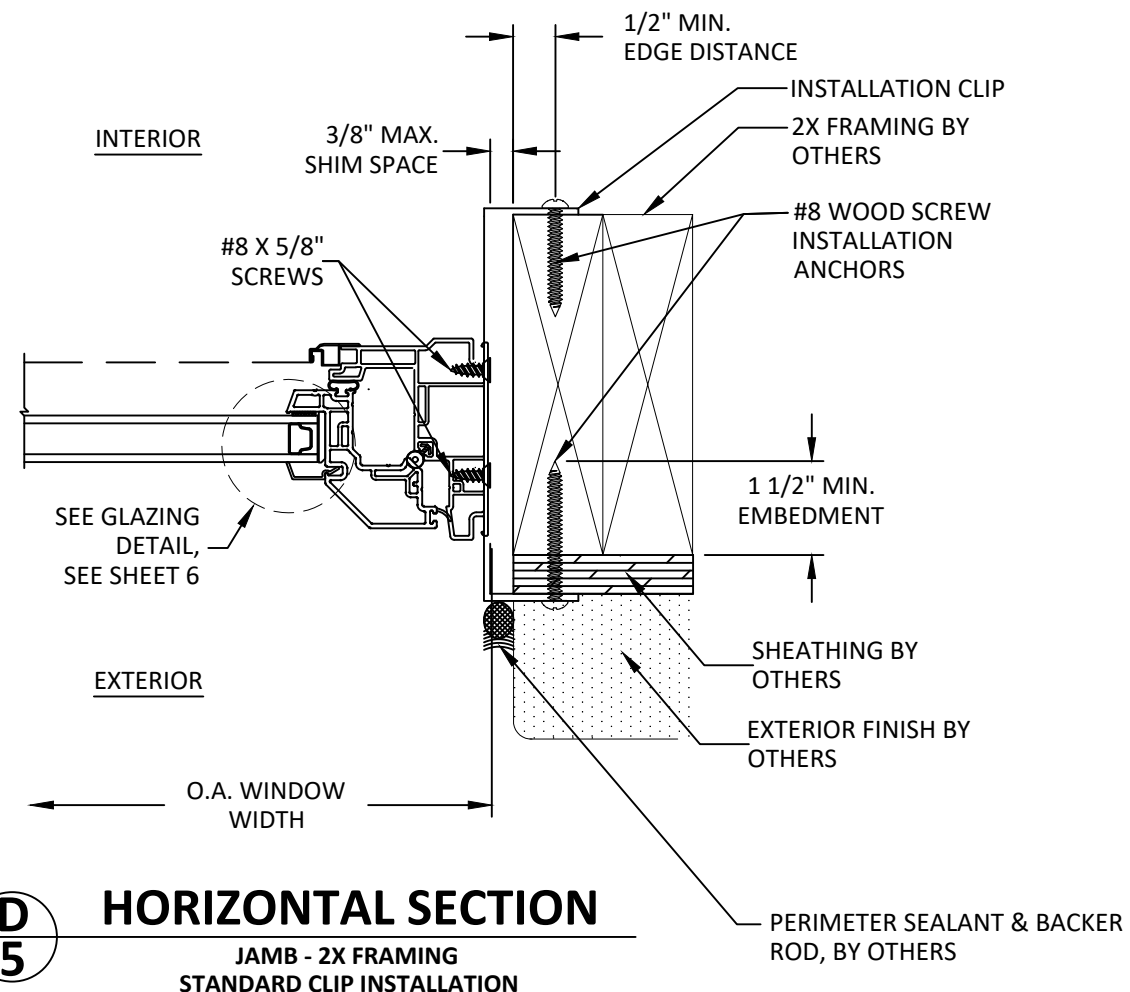

D
5 HORIZONTAL SECTION
JAMB - 2X FRAMING
STANDARD CLIP INSTALLATION



WINDSOR WINDOWS
& DOORS

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938


TITLE:
NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)

HORIZONTAL & VERTICAL SECTIONS
CLIP INSTALLATION

PREPARED BY:


BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

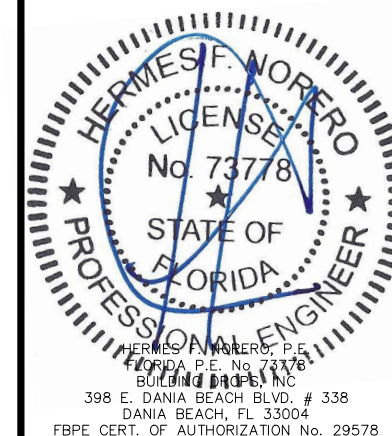

FL #:	FL17785
DATE:	11.13.2020
DWG. BY:	NUS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWD062
SHEET:	5

s:\projects\windsor windows and doors\cc-20-0917-fbc code change (ver. 7)\dwgs\117785\wwd062.dwg 12/23/2020 3:31 PM

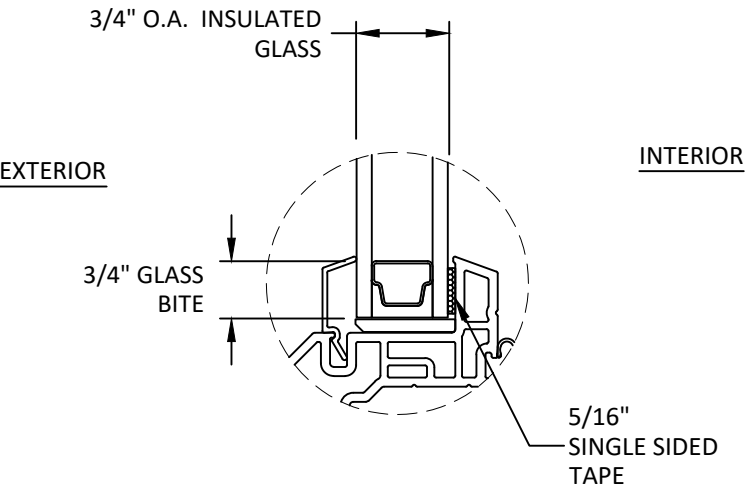

GLAZING DETAIL

- GLAZING NOTES:
- 1. GLASS TYPE & THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE IBC/IRC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - 2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A).
 - 3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36".
 - 4. DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLE ON SHEET 1.



WINDSOR WINDOWS & DOORS


900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:

NEXT DIMENSION
SIGNATURE CASEMENT
(NON-HVHZ)(NON-IMPACT)

GLAZING DETAILS


PREPARED BY:



BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL17785

DATE: **11.13.2020**

DWG. BY: NUS	CHK. BY: HFN
------------------------	------------------------

SCALE: **NTS**

DWG. #: **WWD062**

SHEET:

6